

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



May 25, 2021

Mr. Obi Ifedigbo
Roosevelt Union Free School District
Administration Building
240 Denton Place
Roosevelt, New York 11575

Re: **Lead Testing in School Drinking Water
2020 Compliance 10 NYCRR Subpart 67-4**

JCB#: **19-45373**

Dear Mr. Ifedigbo:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document, and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 15 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead Testing Results for Applicable Outlets
Attachment 2: Laboratory Analytical Reports
Attachment 3: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.

Sincerely,

A handwritten signature in black ink, appearing to read 'Tara Ricker', is written over a light blue rectangular background.

Tara Ricker
J C Broderick & Associates, Inc.

Attachment 1:

Lead Testing Results
for Applicable Outlets



J.C. Broderick & Associates, Inc.


Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Roosevelt Union Free School District

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
---------------	----------	------------------	-------------	----------------------	-------------	--------------	------------------------------------

Centennial Avenue Elementary School

RUFSD-0281	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/28/2021	5.8	Result Below Action Level, Continue O&M
RUFSD-0282	N/A	Kitchen	Spray Nozzle	Non-Potable	4/28/2021	1.1	Result Below Action Level, Continue O&M
RUFSD-0283	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0284	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0285	N/A	Kitchen	Ice Machine	Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0286	N/A	Kitchen	Kitchen Faucet (Cold)	Potable	4/28/2021	5.0	Result Below Action Level, Continue O&M
RUFSD-0287	N/A	Kitchen	Pasta Pot/Steam Kettle	Potable	4/28/2021	2.2	Result Below Action Level, Continue O&M
RUFSD-0288	N/A	Kitchen	Kitchen Faucet (Cold)	Potable	4/28/2021	23	Removed From Service, Pending Remediation
RUFSD-0289	N/A	Kitchen	Spray Nozzle	Potable	4/28/2021	4.4	Result Below Action Level, Continue O&M
RUFSD-0290	N/A	Kitchen	Hand Wash Only	Non-Potable	4/28/2021	5.3	Result Below Action Level, Continue O&M
RUFSD-0291	N/A	Kitchen Serving Area	Hand Wash Only	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0292	N/A	Kitchen Serving Area	Kitchen Faucet (Cold)	Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0293	N/A	1st Floor Faculty Lounge	Kitchen Faucet (Cold)	Non-Potable	4/28/2021	2.3	Result Below Action Level, Continue O&M
RUFSD-0294	N/A	Custodial Closet (Trash/Trays)	Kitchen Non Potable	Non-Potable	4/28/2021	OOS	Testing Required Before Return to Service
RUFSD-0296	N/A	Cafeteria	Water Cooler	Potable	4/28/2021	OOS	Testing Required Before Return to Service
RUFSD-0300	N/A	1st Floor Corridor Kitchen to Receiving Area (Adjacent to Girl's Bathroom)	Water Fountain-No Chiller	Potable	4/28/2021	OOS	Testing Required Before Return to Service
RUFSD-0301	N/A	1st Floor Corridor Kitchen to Receiving Area (Adjacent to Girl's Bathroom)	Water Fountain-No Chiller	Potable	4/28/2021	OOS	Testing Required Before Return to Service
RUFSD-0308	N/A	Main Office Principal's Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	49	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0310	N/A	Main Office Staff Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	11	Result Below Action Level, Continue O&M
RUFSD-0312	N/A	Main Office Kitchenette	Kitchen Faucet (Cold)	Non-Potable	4/28/2021	1	Result Below Action Level, Continue O&M
RUFSD-0313	N/A	Room 1004	Classroom Faucet	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0314	N/A	Room 1004	Water Fountain-No Chiller	Potable	4/28/2021	1.5	Result Below Action Level, Continue O&M
RUFSD-0315	N/A	Shared Bathroom in Room 1004 & Room 1006	Bathroom Faucet	Non-Potable	4/28/2021	17	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0317	N/A	Room 1006	Classroom Faucet	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0318	N/A	Room 1006	Water Fountain-No Chiller	Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0319	N/A	Room 1007	Classroom Faucet	Non-Potable	4/28/2021	9.5	Result Below Action Level, Continue O&M
RUFSD-0320	N/A	Room 1007	Water Fountain-No Chiller	Potable	4/28/2021	3.1	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0321	N/A	Shared Bathroom in Room 1007 & Nurse's Office	Bathroom Faucet	Non-Potable	4/28/2021	190	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0323	N/A	Nurse's Office (1008) Medication Room 1012	Nurse's Office Sink	Potable	4/28/2021	1.1	Result Below Action Level, Continue O&M
RUFSD-0324	N/A	Nurse's Office (1008) Exam Room 1011	Nurse's Office Sink	Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0325	N/A	Room 1030	Classroom Faucet	Non-Potable	4/28/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0326	N/A	Room 1030	Water Fountain-No Chiller	Potable	4/28/2021	3.3	Result Below Action Level, Continue O&M
RUFSD-0327	N/A	Shared Bathroom in Room 1030 & Room 1028	Bathroom Faucet	Non-Potable	4/28/2021	12	Result Below Action Level, Continue O&M
RUFSD-0329	N/A	Room 1028	Classroom Faucet	Non-Potable	4/28/2021	4.3	Result Below Action Level, Continue O&M
RUFSD-0330	N/A	Room 1028	Water Fountain-No Chiller	Potable	4/28/2021	1.8	Result Below Action Level, Continue O&M
RUFSD-0332	N/A	Room 1026	Classroom Faucet	Non-Potable	4/28/2021	3.9	Result Below Action Level, Continue O&M
RUFSD-0333	N/A	Room 1026	Water Fountain-No Chiller	Potable	4/28/2021	28	Removed From Service, Pending Remediation
RUFSD-0334	N/A	Room 1026 Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0336	N/A	1st Floor Corridor Main Lobby to Room 1023 (Across From Room 1021)	Water Fountain-No Chiller	Potable	4/28/2021	OOS	Testing Required Before Return to Service
RUFSD-0337	N/A	1st Floor Corridor Main Lobby to Room 1023 (Across From Room 1021)	Water Fountain-No Chiller	Potable	4/28/2021	OOS	Testing Required Before Return to Service
RUFSD-0338	N/A	Room 1021	Classroom Faucet	Non-Potable	4/28/2021	3.2	Result Below Action Level, Continue O&M
RUFSD-0339	N/A	Room 1021	Water Fountain-No Chiller	Potable	4/28/2021	1.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0340	N/A	Shared Bathroom in Room 1021 & Room 1023	Bathroom Faucet	Non-Potable	4/28/2021	17	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0342	N/A	Room 1023	Classroom Faucet	Non-Potable	4/28/2021	1.7	Result Below Action Level, Continue O&M
RUFSD-0343	N/A	Room 1023	Water Fountain-No Chiller	Potable	4/28/2021	1.4	Result Below Action Level, Continue O&M
RUFSD-0344	N/A	Room 1042	Classroom Faucet	Non-Potable	4/28/2021	5.7	Result Below Action Level, Continue O&M
RUFSD-0345	N/A	Room 1042	Water Fountain-No Chiller	Potable	4/28/2021	16	Removed From Service, Pending Remediation
RUFSD-0346	N/A	Shared Bathroom in Room 1042 & Room 1045	Bathroom Faucet	Non-Potable	4/28/2021	3.3	Result Below Action Level, Continue O&M
RUFSD-0348	N/A	Room 1045	Classroom Faucet	Non-Potable	4/28/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0349	N/A	Room 1045	Water Fountain-No Chiller	Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0350	N/A	First Floor Café (Adjacent to Room 1045)	Kitchen Faucet (Cold)	Non-Potable	4/28/2021	3.3	Result Below Action Level, Continue O&M
RUFSD-0351	N/A	Room 1048	Classroom Faucet	Non-Potable	4/28/2021	1.8	Result Below Action Level, Continue O&M
RUFSD-0352	N/A	Room 1048	Water Fountain-No Chiller	Potable	4/28/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0353	N/A	Shared Bathroom in Room 1048 & Room 1050	Bathroom Faucet	Non-Potable	4/28/2021	1.8	Result Below Action Level, Continue O&M
RUFSD-0355	N/A	Room 1050	Classroom Faucet	Non-Potable	4/28/2021	3.7	Result Below Action Level, Continue O&M
RUFSD-0356	N/A	Room 1050	Water Fountain-No Chiller	Potable	4/28/2021	2.6	Result Below Action Level, Continue O&M
RUFSD-0357	N/A	Room 1056	Classroom Faucet	Non-Potable	4/28/2021	1.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0358	N/A	Room 1056	Water Fountain-No Chiller	Potable	4/28/2021	3.6	Result Below Action Level, Continue O&M
RUFSD-0359	N/A	Shared Bathroom in Room 1056 & Room 1054	Bathroom Faucet	Non-Potable	4/28/2021	7.7	Result Below Action Level, Continue O&M
RUFSD-0361	N/A	Room 1054	Classroom Faucet	Non-Potable	4/28/2021	1.1	Result Below Action Level, Continue O&M
RUFSD-0362	N/A	Room 1054	Water Fountain-No Chiller	Potable	4/28/2021	2.4	Result Below Action Level, Continue O&M
RUFSD-0363	N/A	Room 1052	Classroom Faucet	Non-Potable	4/28/2021	2.2	Result Below Action Level, Continue O&M
RUFSD-0364	N/A	Room 1052	Water Fountain-No Chiller	Potable	4/28/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0365	N/A	Room 1052 Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	12	Result Below Action Level, Continue O&M
RUFSD-0367	N/A	Music Room 2030	Classroom Faucet	Non-Potable	4/28/2021	1.7	Result Below Action Level, Continue O&M
RUFSD-0368	N/A	Room 2028 Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	11	Result Below Action Level, Continue O&M
RUFSD-0370	N/A	Room 2023	Classroom Faucet	Non-Potable	4/28/2021	4.2	Result Below Action Level, Continue O&M
RUFSD-0371	N/A	Room 2023	Water Fountain-No Chiller	Potable	4/28/2021	2.8	Result Below Action Level, Continue O&M
RUFSD-0372	N/A	Room 2023 Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	22	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0374	N/A	2nd Floor Faculty Bathroom (Adjacent to Room 2020)	Bathroom Faucet	Non-Potable	4/28/2021	5.5	Result Below Action Level, Continue O&M
RUFSD-0377	N/A	2nd Floor Corridor Room 2008 to Library (Across From Room 2008)	Water Fountain-No Chiller	Potable	4/28/2021	OOS	Testing Required Before Return to Service
RUFSD-0378	N/A	2nd Floor Corridor Room 2008 to Library (Across From Room 2008)	Water Fountain-No Chiller	Potable	4/28/2021	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0379	N/A	2nd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0380	N/A	2nd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	2.1	Result Below Action Level, Continue O&M
RUFSD-0381	N/A	2nd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	6.2	Result Below Action Level, Continue O&M
RUFSD-0383	N/A	2nd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	6.7	Result Below Action Level, Continue O&M
RUFSD-0384	N/A	2nd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	5.1	Result Below Action Level, Continue O&M
RUFSD-0385	N/A	2nd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0387	N/A	3rd Floor Corridor (Across From Room 3008)	Water Fountain-No Chiller	Potable	4/28/2021	OOS	Testing Required Before Return to Service
RUFSD-0388	N/A	3rd Floor Corridor (Across From Room 3008)	Water Fountain-No Chiller	Potable	4/28/2021	OOS	Testing Required Before Return to Service
RUFSD-0390	N/A	3rd Floor Faculty Lounge	Kitchen Faucet (Cold)	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0391	N/A	3rd Floor Faculty Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	2.4	Result Below Action Level, Continue O&M
RUFSD-0393	N/A	Room 3023	Classroom Faucet	Non-Potable	4/28/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0394	N/A	Room 3023	Water Fountain-No Chiller	Potable	4/28/2021	5.1	Result Below Action Level, Continue O&M
RUFSD-0395	N/A	Room 3023 Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	9.7	Result Below Action Level, Continue O&M
RUFSD-0397	N/A	Room 3020 Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	1.5	Result Below Action Level, Continue O&M
RUFSD-0399	N/A	Art Room 3030	Classroom Faucet	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0400	N/A	3rd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	2.1	Result Below Action Level, Continue O&M
RUFSD-0401	N/A	3rd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0402	N/A	3rd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	2.1	Result Below Action Level, Continue O&M
RUFSD-0404	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	8.2	Result Below Action Level, Continue O&M
RUFSD-0405	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	2.1	Result Below Action Level, Continue O&M
RUFSD-0406	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/28/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0408	N/A	Library Office (Closest to Bathroom)	Hand Wash Only	Non-Potable	4/28/2021	4.0	Result Below Action Level, Continue O&M

Roosevelt HS

RUFSD-0654	N/A	Kitchen Serving Area	Hand Wash Only	Non-Potable	4/30/2021	1.8	Result Below Action Level, Continue O&M
RUFSD-0655	N/A	Kitchen Serving Area	Hand Wash Only	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0656	N/A	Kitchen Serving Area	Hand Wash Only	Non-Potable	4/30/2021	5.2	Result Below Action Level, Continue O&M
RUFSD-0657	N/A	Kitchen Serving Area	Hand Wash Only	Non-Potable	4/30/2021	3.6	Result Below Action Level, Continue O&M
RUFSD-0658	N/A	Kitchen	Hand Wash Only	Non-Potable	4/30/2021	8.6	Result Below Action Level, Continue O&M
RUFSD-0659	N/A	Kitchen	Kitchen Faucet (Cold)	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0660	N/A	Kitchen	Spray Nozzle	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0661	N/A	Kitchen	Hand Wash Only	Non-Potable	4/30/2021	4.8	Result Below Action Level, Continue O&M
RUFSD-0662	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0663	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0664	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0665	N/A	Kitchen	Spray Nozzle	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0666	N/A	Kitchen	Ice Machine	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0667	N/A	Kitchen	Pasta Pot/Steam Kettle	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0668	N/A	Kitchen	Kitchen Faucet (Cold)	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0672	N/A	Culinary Arts Lab 135A	Hand Wash Only	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0673	N/A	Culinary Arts Lab 135A	Hand Wash Only	Non-Potable	4/30/2021	31	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0674	N/A	Culinary Arts Lab 135A	Spray Nozzle	Potable	4/30/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0675	N/A	Culinary Arts Lab 135A	Kitchen Faucet (Cold)	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0676	N/A	Culinary Arts Lab 135A	Hand Wash Only	Non-Potable	4/30/2021	7.2	Result Below Action Level, Continue O&M
RUFSD-0677	N/A	Culinary Arts Lab 135A	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	8.7	Result Below Action Level, Continue O&M
RUFSD-0678	N/A	Culinary Arts Lab 135A	Spray Nozzle	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0679	N/A	Culinary Arts Lab 135A	Kitchen Faucet (Cold)	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0680	N/A	Culinary Arts Lab 135A	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0681	N/A	Culinary Arts Lab 135A	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0682	N/A	Culinary Arts Lab 135A	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0683	N/A	Culinary Arts Lab 135A	Spray Nozzle	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0684	N/A	Culinary Arts Lab 135A	Kitchen Faucet (Cold)	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0685	N/A	Culinary Arts Lab 135A	Pasta Pot/Steam Kettle	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0686	N/A	Boces Medical Assistant Lab 137B	Classroom Faucet	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0687	N/A	Boces Medical Assistant Lab 137B	Classroom Faucet	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0688	N/A	Boces Medical Assistant Lab 137B	Classroom Faucet	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0689	N/A	Boces Medical Assistant Lab 137B	Classroom Faucet	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0690	N/A	Boces Medical Assistant Lab 137B	Classroom Faucet	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0702	N/A	1st Floor Corridor C Room C165 to Room C151 (Across From Bathrooms)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0703	N/A	1st Floor Corridor C Room C165 to Room C151 (Across From Bathrooms)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0750	N/A	1st Floor Corridor B Room B147 to Room B142 (Adjacent to Girl's Gang Bathroom)	Water Cooler	Potable	4/30/2021	1.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0751	N/A	1st Floor Corridor B Room B147 to Room B142 (Adjacent to Girl's Gang Bathroom)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0804	N/A	1st Floor Corridor Girl's Locker Room to Boy's Locker Room (Inside Exit Vestibule)	Bottle Fill Station	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0805	N/A	1st Floor Corridor Girl's Locker Room to Boy's Locker Room (Inside Exit Vestibule)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0806	N/A	1st Floor Corridor Girl's Locker Room to Boy's Locker Room (Inside Exit Vestibule)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0811	N/A	Fitness Center 036	Bottle Fill Station	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0812	N/A	Fitness Center 036	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0813	N/A	Fitness Center 036	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0816	N/A	JROTC Room 034	Classroom Faucet	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0826	N/A	1st Floor Corridor Athletic Director Office to Kitchen (Adjacent to Office 032)	Bottle Fill Station	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0827	N/A	1st Floor Corridor Athletic Director Office to Kitchen (Adjacent to Office 032)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0828	N/A	1st Floor Corridor Athletic Director Office to Kitchen (Adjacent to Office 032)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0836	N/A	1st Floor Corridor Library to Cafeteria (Across From Rooms 016 & 014)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0837	N/A	1st Floor Corridor Library to Cafeteria (Across From Rooms 016 & 014)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0849	N/A	Library Office 011E	Hand Wash Only	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0852	N/A	Nurse's Office	Nurse's Office Sink	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0857	N/A	Main Office 010 Kitchenette	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0858	N/A	Main Office 010 Kitchenette	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0859	N/A	Main Office 010 Kitchenette	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0862	N/A	Health Clinic 051 Nurse Practitioner's Office	Hand Wash Only	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0863	N/A	Health Clinic 051 Examination Room	Nurse's Office Sink	Potable	4/30/2021	7.1	Result Below Action Level, Continue O&M
RUFSD-0874	N/A	Office 054	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0875	N/A	Office 054	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0876	N/A	Staff Room 062	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0877	N/A	Human Resources Office 066	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0878	N/A	Human Resources Office 066	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0879	N/A	Business Office 057	Bottled Water Dispenser	Potable	4/30/2021	OOS	Testing Required Before Return to Service
RUFSD-0880	N/A	Business Office 057	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0904	N/A	Corridor A Administration Room A110	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0905	N/A	Corridor A Administration Room A110	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0908	N/A	1st Floor Corridor A Room A109 to Room A115 (Adjacent to Room A109)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0909	N/A	1st Floor Corridor A Room A109 to Room A115 (Adjacent to Room A109)	Water Cooler	Potable	4/30/2021	1.2	Result Below Action Level, Continue O&M
RUFSD-0918	N/A	2nd Floor Corridor A Room 200 to Room 215 (Across From Room A200)	Water Cooler	Potable	4/30/2021	1.3	Result Below Action Level, Continue O&M
RUFSD-0919	N/A	2nd Floor Corridor A Room 200 to Room 215 (Across From Room A200)	Water Cooler	Potable	4/30/2021	1	Result Below Action Level, Continue O&M
RUFSD-0933	N/A	Life Skills Room A216	Home Economics Faucet (Cold)	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0942	N/A	2nd Floor Faculty Lounge B239	Kitchen Faucet (Cold)	Non-Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0952	N/A	2nd Floor Corridor B Room B243 to Room B230 (Across From Gang Bathrooms)	Water Cooler	Potable	4/30/2021	OOS	Testing Required Before Return to Service
RUFSD-0953	N/A	2nd Floor Corridor B Room B243 to Room B230 (Across From Gang Bathrooms)	Water Cooler	Potable	4/30/2021	OOS	Testing Required Before Return to Service
RUFSD-0977	N/A	2nd Floor Corridor C Room C268 to Room C250 (Adjacent to Room C259)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0978	N/A	2nd Floor Corridor C Room C268 to Room C250 (Adjacent to Room C259)	Water Cooler	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-1014	N/A	Nurse's Office Exam Room 015B	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-1015	N/A	Nurse's Office Exam Room 015B	Bottled Water Dispenser	Potable	4/30/2021	<3.0 ND	Result Below Action Level, Continue O&M

Roosevelt Middle School

RUFSD-0420	N/A	Kitchen Serving Area	Hand Wash Only	Non-Potable	4/29/2021	2.1	Result Below Action Level, Continue O&M
RUFSD-0421	N/A	Kitchen Serving Area	Kitchen Faucet (Cold)	Potable	4/29/2021	2.5	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0422	N/A	Kitchen Serving Area	Kitchen Faucet (Cold)	Potable	4/29/2021	2.7	Result Below Action Level, Continue O&M
RUFSD-0423	N/A	Snack Bar Room 1440B	Hand Wash Only	Non-Potable	4/29/2021	28	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0424	N/A	Kitchen	Ice Machine	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0425	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	3.3	Result Below Action Level, Continue O&M
RUFSD-0426	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	4.5	Result Below Action Level, Continue O&M
RUFSD-0427	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	4.1	Result Below Action Level, Continue O&M
RUFSD-0428	N/A	Kitchen	Hand Wash Only	Non-Potable	4/29/2021	2.8	Result Below Action Level, Continue O&M
RUFSD-0429	N/A	Kitchen	Spray Nozzle	Potable	4/29/2021	3.7	Result Below Action Level, Continue O&M
RUFSD-0430	N/A	Kitchen	Kitchen Faucet (Cold)	Potable	4/29/2021	3.1	Result Below Action Level, Continue O&M
RUFSD-0431	N/A	Kitchen	Pasta Pot/Steam Kettle	Potable	4/29/2021	6.0	Result Below Action Level, Continue O&M
RUFSD-0433	N/A	Cafeteria	Water Cooler	Potable	4/29/2021	1.1	Result Below Action Level, Continue O&M
RUFSD-0434	N/A	Staff Room 1420	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	2.9	Result Below Action Level, Continue O&M
RUFSD-0435	N/A	Male Staff Locker Room	Bathroom Faucet	Non-Potable	4/29/2021	25	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0437	N/A	Female Staff Locker Room	Bathroom Faucet	Non-Potable	4/29/2021	8.9	Result Below Action Level, Continue O&M
RUFSD-0439	N/A	Music Room 1403	Classroom Faucet	Non-Potable	4/29/2021	4.0	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0440	N/A	Music Room 1403	Water Fountain-No Chiller	Potable	4/29/2021	1.2	Result Below Action Level, Continue O&M
RUFSD-0441	N/A	Music Room 1403	Water Fountain-No Chiller	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0442	N/A	Faculty Lounge in Cafeteria	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	9.0	Result Below Action Level, Continue O&M
RUFSD-0443	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	26	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0444	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	13	Result Below Action Level, Continue O&M
RUFSD-0445	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	9.8	Result Below Action Level, Continue O&M
RUFSD-0446	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	12	Result Below Action Level, Continue O&M
RUFSD-0447	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	7.4	Result Below Action Level, Continue O&M
RUFSD-0450	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	7.8	Result Below Action Level, Continue O&M
RUFSD-0451	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	6.3	Result Below Action Level, Continue O&M
RUFSD-0452	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	5.6	Result Below Action Level, Continue O&M
RUFSD-0453	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	7.5	Result Below Action Level, Continue O&M
RUFSD-0454	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	Bathroom Faucet	Non-Potable	4/29/2021	9.4	Result Below Action Level, Continue O&M
RUFSD-0456	N/A	Boys Coach's Office 1206 Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	4.6	Result Below Action Level, Continue O&M
RUFSD-0459	N/A	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	19	Placarded for Non-Drinking Use, Pending Remediation

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0460	N/A	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	8.6	Result Below Action Level, Continue O&M
RUFSD-0462	N/A	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	5.2	Result Below Action Level, Continue O&M
RUFSD-0463	N/A	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	15	Result Below Action Level, Continue O&M
RUFSD-0466	N/A	Girls Coach's Office 1219 Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	41	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0468	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	7.7	Result Below Action Level, Continue O&M
RUFSD-0469	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	11	Result Below Action Level, Continue O&M
RUFSD-0470	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	21	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0471	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	7.1	Result Below Action Level, Continue O&M
RUFSD-0472	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	8.9	Result Below Action Level, Continue O&M
RUFSD-0475	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	2.9	Result Below Action Level, Continue O&M
RUFSD-0476	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	3.1	Result Below Action Level, Continue O&M
RUFSD-0477	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	6.3	Result Below Action Level, Continue O&M
RUFSD-0478	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	1.2	Result Below Action Level, Continue O&M
RUFSD-0479	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	Bathroom Faucet	Non-Potable	4/29/2021	16	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0482	N/A	Main Office Principal Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	4.1	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0484	N/A	Main Office Staff Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0486	N/A	Main Office Kitchenette	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	2.2	Result Below Action Level, Continue O&M
RUFSD-0487	N/A	Main Office Kitchenette	Bottled Water Dispenser	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0488	N/A	Main Office Kitchenette	Bottled Water Dispenser	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0489	N/A	PPS Offices Kitchenette	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	2.6	Result Below Action Level, Continue O&M
RUFSD-0490	N/A	PPS Offices Kitchenette	Bottled Water Dispenser	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0491	N/A	PPS Offices Kitchenette	Bottled Water Dispenser	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0492	N/A	PPS Bathroom (Across From Room 1016)	Bathroom Faucet	Non-Potable	4/29/2021	5.3	Result Below Action Level, Continue O&M
RUFSD-0494	N/A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	14	Result Below Action Level, Continue O&M
RUFSD-0496	N/A	Nurse's Office Exam Room 1310	Nurse's Office Sink	Potable	4/29/2021	10	Result Below Action Level, Continue O&M
RUFSD-0497	N/A	Nurse's Office Exam Room 1310	Bottled Water Dispenser	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0498	N/A	Nurse's Office Exam Room 1310	Bottled Water Dispenser	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0499	N/A	1st Floor Corridor PPS Offices to Room 1347 (Across Room 1322)	Water Fountain-No Chiller	Potable	4/29/2021	1.8	Result Below Action Level, Continue O&M
RUFSD-0500	N/A	1st Floor Corridor PPS Offices to Room 1347 (Across Room 1322)	Water Fountain-No Chiller	Potable	4/29/2021	2.3	Result Below Action Level, Continue O&M
RUFSD-0501	N/A	1st Floor Corridor PPS Offices to Room 1347 (Across Room 1322)	Water Fountain-No Chiller	Potable	4/29/2021	1.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0502	N/A	1st Floor Corridor PPS Offices to Room 1347 (Across Room 1322)	Water Fountain-No Chiller	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0503	N/A	1st Floor Boys Gang Bathroom (Adjacent to Custodial Closet 1333)	Bathroom Faucet	Non-Potable	4/29/2021	16	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0504	N/A	1st Floor Boys Gang Bathroom (Adjacent to Custodial Closet 1333)	Bathroom Faucet	Non-Potable	4/29/2021	59	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0505	N/A	1st Floor Boys Gang Bathroom (Adjacent to Custodial Closet 1333)	Bathroom Faucet	Non-Potable	4/29/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0508	N/A	1st Floor Girls Gang Bathroom (Adjacent to Custodial Closet 1333)	Bathroom Faucet	Non-Potable	4/29/2021	10	Result Below Action Level, Continue O&M
RUFSD-0509	N/A	1st Floor Girls Gang Bathroom (Adjacent to Custodial Closet 1333)	Bathroom Faucet	Non-Potable	4/29/2021	13	Result Below Action Level, Continue O&M
RUFSD-0510	N/A	1st Floor Girls Gang Bathroom (Adjacent to Custodial Closet 1333)	Bathroom Faucet	Non-Potable	4/29/2021	23	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0512	N/A	Room 1337 Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	5.1	Result Below Action Level, Continue O&M
RUFSD-0514	N/A	1st Floor Faculty Lounge 1347	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	3.6	Result Below Action Level, Continue O&M
RUFSD-0515	N/A	1st Floor Faculty Lounge 1347 Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	15	Result Below Action Level, Continue O&M
RUFSD-0517	N/A	3rd Floor Kitchenette (Mail/Copy 3005)	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	3.6	Result Below Action Level, Continue O&M
RUFSD-0518	N/A	3rd Floor Principal Office Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	2.4	Result Below Action Level, Continue O&M
RUFSD-0552	N/A	3rd Floor Corridor Room 3305 to Room 3340 (Across Room 3319)	Water Fountain-No Chiller	Potable	4/29/2021	OOS	Testing Required Before Return to Service
RUFSD-0553	N/A	3rd Floor Corridor Room 3305 to Room 3340 (Across Room 3319)	Water Fountain-No Chiller	Potable	4/29/2021	OOS	Testing Required Before Return to Service
RUFSD-0554	N/A	3rd Floor Corridor Room 3305 to Room 3340 (Across Room 3319)	Water Fountain-No Chiller	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0555	N/A	3rd Floor Corridor Room 3305 to Room 3340 (Across Room 3319)	Water Fountain-No Chiller	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0556	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	3.8	Result Below Action Level, Continue O&M
RUFSD-0557	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	2.5	Result Below Action Level, Continue O&M
RUFSD-0558	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	3.1	Result Below Action Level, Continue O&M
RUFSD-0561	N/A	3rd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	3.8	Result Below Action Level, Continue O&M
RUFSD-0562	N/A	3rd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	4.5	Result Below Action Level, Continue O&M
RUFSD-0563	N/A	3rd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	9.6	Result Below Action Level, Continue O&M
RUFSD-0565	N/A	Room 3330 Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	4.7	Result Below Action Level, Continue O&M
RUFSD-0567	N/A	3rd Floor Faculty Lounge 3340	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	1.3	Result Below Action Level, Continue O&M
RUFSD-0568	N/A	3rd Floor Faculty Lounge 3340 Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	3.0	Result Below Action Level, Continue O&M
RUFSD-0570	N/A	2nd Floor Faculty Lounge 2340	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	3.3	Result Below Action Level, Continue O&M
RUFSD-0571	N/A	2nd Floor Faculty Lounge 2340 Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	5.6	Result Below Action Level, Continue O&M
RUFSD-0573	N/A	Room 2330 Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	7.9	Result Below Action Level, Continue O&M
RUFSD-0575	N/A	2nd Floor Girls Gang Bathroom (Adjacent Room 2330)	Bathroom Faucet	Non-Potable	4/29/2021	6.1	Result Below Action Level, Continue O&M
RUFSD-0576	N/A	2nd Floor Girls Gang Bathroom (Adjacent Room 2330)	Bathroom Faucet	Non-Potable	4/29/2021	4.2	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0577	N/A	2nd Floor Girls Gang Bathroom (Adjacent Room 2330)	Bathroom Faucet	Non-Potable	4/29/2021	4.1	Result Below Action Level, Continue O&M
RUFSD-0580	N/A	2nd Floor Boys Gang Bathroom (Adjacent Room 2321)	Bathroom Faucet	Non-Potable	4/29/2021	4.1	Result Below Action Level, Continue O&M
RUFSD-0581	N/A	2nd Floor Boys Gang Bathroom (Adjacent Room 2321)	Bathroom Faucet	Non-Potable	4/29/2021	6.4	Result Below Action Level, Continue O&M
RUFSD-0582	N/A	2nd Floor Boys Gang Bathroom (Adjacent Room 2321)	Bathroom Faucet	Non-Potable	4/29/2021	4.3	Result Below Action Level, Continue O&M
RUFSD-0616	N/A	2nd Floor Corridor Room 2305 to Room 2340 (Across Room 2319)	Water Fountain-No Chiller	Potable	4/29/2021	OOS	Testing Required Before Return to Service
RUFSD-0617	N/A	2nd Floor Corridor Room 2305 to Room 2340 (Across Room 2319)	Water Fountain-No Chiller	Potable	4/29/2021	OOS	Testing Required Before Return to Service
RUFSD-0618	N/A	2nd Floor Corridor Room 2305 to Room 2340 (Across Room 2319)	Water Fountain-No Chiller	Potable	4/29/2021	1.4	Result Below Action Level, Continue O&M
RUFSD-0619	N/A	2nd Floor Corridor Room 2305 to Room 2340 (Across Room 2319)	Water Fountain-No Chiller	Potable	4/29/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0620	N/A	2nd Floor Kitchenette (Mail/Copy 2004)	Kitchen Faucet (Cold)	Non-Potable	4/29/2021	3.5	Result Below Action Level, Continue O&M
RUFSD-0621	N/A	Office 2004 Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	2.5	Result Below Action Level, Continue O&M
RUFSD-0623	N/A	Library Office 2108	Hand Wash Only	Non-Potable	4/29/2021	9.4	Result Below Action Level, Continue O&M
RUFSD-0630	N/A	2nd Floor Art Room Wing Boys Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	13	Result Below Action Level, Continue O&M
RUFSD-0631	N/A	2nd Floor Art Room Wing Boys Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	16	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0632	N/A	2nd Floor Art Room Wing Boys Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	5.9	Result Below Action Level, Continue O&M
RUFSD-0634	N/A	2nd Floor Art Room Wing Girls Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	13	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0635	N/A	2nd Floor Art Room Wing Girls Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	21	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0636	N/A	2nd Floor Art Room Wing Girls Bathroom	Bathroom Faucet	Non-Potable	4/29/2021	12	Result Below Action Level, Continue O&M
RUFSD-0640	N/A	Home Economics Room 2422	Home Economics Faucet (Cold)	Potable	4/29/2021	2.4	Result Below Action Level, Continue O&M
RUFSD-0641	N/A	Home Economics Room 2422	Home Economics Faucet (Cold)	Potable	4/29/2021	9.9	Result Below Action Level, Continue O&M
RUFSD-0642	N/A	Home Economics Room 2422	Home Economics Faucet (Cold)	Potable	4/29/2021	4.9	Result Below Action Level, Continue O&M
RUFSD-0643	N/A	Home Economics Room 2422	Home Economics Faucet (Cold)	Potable	4/29/2021	4.6	Result Below Action Level, Continue O&M
RUFSD-0644	N/A	Home Economics Room 2422	Home Economics Faucet (Cold)	Potable	4/29/2021	1.8	Result Below Action Level, Continue O&M
RUFSD-0647	N/A	Home Economics Room 2424	Home Economics Faucet (Cold)	Potable	4/29/2021	3.2	Result Below Action Level, Continue O&M
RUFSD-0648	N/A	Home Economics Room 2424	Home Economics Faucet (Cold)	Potable	4/29/2021	3.4	Result Below Action Level, Continue O&M
RUFSD-0649	N/A	Home Economics Room 2424	Home Economics Faucet (Cold)	Potable	4/29/2021	13	Result Below Action Level, Continue O&M
RUFSD-0650	N/A	Home Economics Room 2424	Home Economics Faucet (Cold)	Potable	4/29/2021	12	Result Below Action Level, Continue O&M
RUFSD-0651	N/A	Home Economics Room 2424	Home Economics Faucet (Cold)	Potable	4/29/2021	15	Result Below Action Level, Continue O&M
RUFSD-0998	N/A	Kitchen	Hand Wash Only	Non-Potable	4/29/2021	5.3	Result Below Action Level, Continue O&M

Ulysses Byas Elementary School

RUFSD-0140	N/A	1st Floor Corridor Room 1053 to Gym (Adjacent to Gym Office 1016)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
------------	-----	---	---------------------------	---------	-----------	-----	---

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0141	N/A	1st Floor Corridor Room 1053 to Gym (Adjacent to Gym Office 1016)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0146	N/A	Inside Gym Vestibule (Adjacent to Stage)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0147	N/A	Inside Gym Vestibule (Adjacent to Stage)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0148	N/A	Kitchen	Ice Machine	Potable	4/27/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0149	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/27/2021	4.4	Result Below Action Level, Continue O&M
RUFSD-0150	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/27/2021	5.3	Result Below Action Level, Continue O&M
RUFSD-0151	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/27/2021	15	Result Below Action Level, Continue O&M
RUFSD-0152	N/A	Kitchen	Spray Nozzle	Non-Potable	4/27/2021	2.2	Result Below Action Level, Continue O&M
RUFSD-0153	N/A	Kitchen	Hand Wash Only	Non-Potable	4/27/2021	2.6	Result Below Action Level, Continue O&M
RUFSD-0154	N/A	Kitchen	Pasta Pot/Steam Kettle	Potable	4/27/2021	10	Result Below Action Level, Continue O&M
RUFSD-0155	N/A	Kitchen	Kitchen Faucet (Cold)	Potable	4/27/2021	7.5	Result Below Action Level, Continue O&M
RUFSD-0156	N/A	Kitchen	Kitchen Faucet (Cold)	Potable	4/27/2021	15	Result Below Action Level, Continue O&M
RUFSD-0157	N/A	Kitchen	Spray Nozzle	Non-Potable	4/27/2021	2.9	Result Below Action Level, Continue O&M
RUFSD-0158	N/A	Kitchen Serving Area	Kitchen Faucet (Cold)	Potable	4/27/2021	1.3	Result Below Action Level, Continue O&M
RUFSD-0159	N/A	Kitchen Serving Area	Hand Wash Only	Non-Potable	4/27/2021	4.0	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0161	N/A	1st Floor Faculty Lounge 1008	Kitchen Faucet (Cold)	Non-Potable	4/27/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0162	N/A	Pantry Storage 1005A (Across From Boy's Locker Room)	Kitchen Non Potable	Non-Potable	4/27/2021	9.6	Result Below Action Level, Continue O&M
RUFSD-0167	N/A	1st Floor Corridor Room 1053 to Gym (Adjacent to Girl's Locker Room)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0168	N/A	1st Floor Corridor Room 1053 to Gym (Adjacent to Girl's Locker Room)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0172	N/A	Main Office Bathroom 1	Bathroom Faucet	Non-Potable	4/27/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0174	N/A	Main Office Bathroom 2	Bathroom Faucet	Non-Potable	4/27/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0176	N/A	Main Office Mail/Copy Room 1039	Kitchen Faucet (Cold)	Potable	4/27/2021	4.2	Result Below Action Level, Continue O&M
RUFSD-0177	N/A	Nurse's Office Exam Room 1066	Nurse's Office Sink	Potable	4/27/2021	3.6	Result Below Action Level, Continue O&M
RUFSD-0178	N/A	Nurse's Office Exam Room 1066	Ice Machine	Potable	4/27/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0181	N/A	Room 1046	Classroom Faucet	Non-Potable	4/27/2021	4.6	Result Below Action Level, Continue O&M
RUFSD-0182	N/A	Room 1046	Water Fountain-No Chiller	Potable	4/27/2021	7.5	Result Below Action Level, Continue O&M
RUFSD-0185	N/A	Room 1062	Classroom Faucet	Non-Potable	4/27/2021	4.0	Result Below Action Level, Continue O&M
RUFSD-0186	N/A	Room 1062	Water Fountain-No Chiller	Potable	4/27/2021	2.9	Result Below Action Level, Continue O&M
RUFSD-0189	N/A	Room 1060	Classroom Faucet	Non-Potable	4/27/2021	4.5	Result Below Action Level, Continue O&M
RUFSD-0190	N/A	Room 1060	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0191	N/A	Room 1048	Classroom Faucet	Non-Potable	4/27/2021	3.3	Result Below Action Level, Continue O&M
RUFSD-0192	N/A	Room 1048	Water Fountain-No Chiller	Potable	4/27/2021	5.0	Result Below Action Level, Continue O&M
RUFSD-0195	N/A	Room 1050	Classroom Faucet	Non-Potable	4/27/2021	8.1	Result Below Action Level, Continue O&M
RUFSD-0196	N/A	Room 1050	Water Fountain-No Chiller	Potable	4/27/2021	8.4	Result Below Action Level, Continue O&M
RUFSD-0197	N/A	Room 1059	Classroom Faucet	Non-Potable	4/27/2021	6.0	Result Below Action Level, Continue O&M
RUFSD-0198	N/A	Room 1059	Water Fountain-No Chiller	Potable	4/27/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0201	N/A	Room 1057	Classroom Faucet	Non-Potable	4/27/2021	4.2	Result Below Action Level, Continue O&M
RUFSD-0202	N/A	Room 1057	Water Fountain-No Chiller	Potable	4/27/2021	6.1	Result Below Action Level, Continue O&M
RUFSD-0203	N/A	Room 1051	Classroom Faucet	Non-Potable	4/27/2021	4.4	Result Below Action Level, Continue O&M
RUFSD-0204	N/A	Room 1051	Water Fountain-No Chiller	Potable	4/27/2021	5.5	Result Below Action Level, Continue O&M
RUFSD-0207	N/A	Room 1053	Classroom Faucet	Non-Potable	4/27/2021	4.1	Result Below Action Level, Continue O&M
RUFSD-0208	N/A	Room 1053	Water Fountain-No Chiller	Potable	4/27/2021	3.6	Result Below Action Level, Continue O&M
RUFSD-0209	N/A	Room 1055	Classroom Faucet	Non-Potable	4/27/2021	2.9	Result Below Action Level, Continue O&M
RUFSD-0210	N/A	Room 1055	Water Fountain-No Chiller	Potable	4/27/2021	5.9	Result Below Action Level, Continue O&M
RUFSD-0213	N/A	Room 2027	Classroom Faucet	Non-Potable	4/27/2021	12	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0214	N/A	Room 2027	Water Fountain-No Chiller	Potable	4/27/2021	3.2	Result Below Action Level, Continue O&M
RUFSD-0221	N/A	2nd Floor Corridor Room 2032 to Room 2012 (Between Gang Bathrooms)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0222	N/A	2nd Floor Corridor Room 2032 to Room 2012 (Between Gang Bathrooms)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0224	N/A	2nd Floor Girls Gang Bathroom	Tempered Water Outlet	Non-Potable		Sticker Replaced	
RUFSD-0226	N/A	2nd Floor Faculty Lounge	Kitchen Faucet (Cold)	Non-Potable	4/27/2021	3.1	Result Below Action Level, Continue O&M
RUFSD-0227	N/A	2nd Floor Principal's Office 2042	Kitchen Faucet (Cold)	Non-Potable	4/27/2021	3.1	Result Below Action Level, Continue O&M
RUFSD-0234	N/A	Library Office	Kitchen Faucet (Cold)	Non-Potable	4/27/2021	8.3	Result Below Action Level, Continue O&M
RUFSD-0235	N/A	Room 2008	Classroom Faucet	Non-Potable	4/27/2021	7.4	Result Below Action Level, Continue O&M
RUFSD-0236	N/A	Room 2008	Water Fountain-No Chiller	Potable	4/27/2021	5.3	Result Below Action Level, Continue O&M
RUFSD-0239	N/A	Room 2017	Classroom Faucet	Non-Potable	4/27/2021	4.3	Result Below Action Level, Continue O&M
RUFSD-0240	N/A	Room 2017	Water Fountain-No Chiller	Potable	4/27/2021	2.4	Result Below Action Level, Continue O&M
RUFSD-0243	N/A	Room 2015	Classroom Faucet	Non-Potable	4/27/2021	6.4	Result Below Action Level, Continue O&M
RUFSD-0244	N/A	Room 2015	Water Fountain-No Chiller	Potable	4/27/2021	5.4	Result Below Action Level, Continue O&M
RUFSD-0245	N/A	Room 2009	Classroom Faucet	Non-Potable	4/27/2021	7.7	Result Below Action Level, Continue O&M
RUFSD-0246	N/A	Room 2009	Water Fountain-No Chiller	Potable	4/27/2021	21	Removed From Service, Pending Remediation

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0249	N/A	Room 2011	Classroom Faucet	Non-Potable	4/27/2021	4.5	Result Below Action Level, Continue O&M
RUFSD-0250	N/A	Room 2011	Water Fountain-No Chiller	Potable	4/27/2021	5.8	Result Below Action Level, Continue O&M
RUFSD-0251	N/A	Science Room 2012	Classroom Faucet	Non-Potable	4/27/2021	39	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0252	N/A	Science Room 2012	Classroom Faucet	Non-Potable	4/27/2021	3.3	Result Below Action Level, Continue O&M
RUFSD-0257	N/A	Room 3003	Classroom Faucet	Non-Potable	4/27/2021	6.2	Result Below Action Level, Continue O&M
RUFSD-0258	N/A	Room 3003	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0261	N/A	Room 3038	Classroom Faucet	Non-Potable	4/27/2021	650	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0262	N/A	Room 3038	Water Fountain-No Chiller	Potable	4/27/2021	11	Result Below Action Level, Continue O&M
RUFSD-0263	N/A	Room 3038	Classroom Faucet	Non-Potable	4/27/2021	6.8	Result Below Action Level, Continue O&M
RUFSD-0267	N/A	3rd Floor Corridor Room 3028 to Room 3010 (Across From Room 3034)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0268	N/A	3rd Floor Corridor Room 3028 to Room 3010 (Across From Room 3034)	Water Fountain-No Chiller	Potable	4/27/2021	OOS	Testing Required Before Return to Service
RUFSD-0272	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/27/2021	1.5	Result Below Action Level, Continue O&M

Washington-Rose Elementary School

RUFSD-0001	N/A	Room 1026	Classroom Faucet	Non-Potable	4/23/2021	1	Result Below Action Level, Continue O&M
RUFSD-0002	N/A	Room 1026	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0003	N/A	Room 1026 Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	21	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0005	N/A	Room 1028	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0006	N/A	Room 1028	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0007	N/A	1st Floor Staff Bathroom (Adjacent to Room 1028)	Bathroom Faucet	Non-Potable	4/23/2021	8.4	Result Below Action Level, Continue O&M
RUFSD-0009	N/A	Room 1025	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0010	N/A	Room 1025	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0011	N/A	Shared Bathroom in Room 1025 & Room 1023	Bathroom Faucet	Non-Potable	4/23/2021	8.1	Result Below Action Level, Continue O&M
RUFSD-0013	N/A	Room 1023	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0014	N/A	Room 1023	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0015	N/A	Nurse's Suite (1034) Exam Room 1031	Nurse's Office Sink	Potable	4/23/2021	4.6	Result Below Action Level, Continue O&M
RUFSD-0016	N/A	Nurse's Suite 1034 Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	25	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0018	N/A	1st Floor Isolation Bathroom (Adjacent to Nurse's Suite 1034)	Bathroom Faucet	Non-Potable	4/23/2021	10	Result Below Action Level, Continue O&M
RUFSD-0020	N/A	1st Floor Corridor Main Lobby to Stairs C (Across Room 1023)	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0021	N/A	1st Floor Corridor Main Lobby to Stairs C (Across Room 1023)	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0022	N/A	Principal's Bathroom (Across From I.S.S Room 1043)	Bathroom Faucet	Non-Potable	4/23/2021	2.7	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0024	N/A	Admin Suite (1044) Mail/Copy Room 1046	Kitchen Faucet (Cold)	Non-Potable	4/23/2021	1.1	Result Below Action Level, Continue O&M
RUFSD-0025	N/A	1st Floor Staff Bathroom (Adjacent to Admin Suite 1044)	Bathroom Faucet	Non-Potable	4/23/2021	5.9	Result Below Action Level, Continue O&M
RUFSD-0027	N/A	Room 1022	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0028	N/A	Room 1022	Hose Bib	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0029	N/A	Room 1022 Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	2.3	Result Below Action Level, Continue O&M
RUFSD-0031	N/A	Room 1004	Classroom Faucet	Non-Potable	4/23/2021	1.3	Result Below Action Level, Continue O&M
RUFSD-0032	N/A	Room 1004	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0033	N/A	Room 1004 Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	7.2	Result Below Action Level, Continue O&M
RUFSD-0035	N/A	Room 1018	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0036	N/A	Room 1018	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0037	N/A	Shared Bathroom in Room 1018 & Room 1016	Bathroom Faucet	Non-Potable	4/23/2021	5.7	Result Below Action Level, Continue O&M
RUFSD-0039	N/A	Room 1016	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0040	N/A	Room 1016	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0041	N/A	Room 1005	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0042	N/A	Room 1005	Water Fountain-No Chiller	Potable	4/23/2021	1.8	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0043	N/A	Shared Bathroom in Room 1005 & Room 1007	Bathroom Faucet	Non-Potable	4/23/2021	2.6	Result Below Action Level, Continue O&M
RUFSD-0045	N/A	Room 1007	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0046	N/A	Room 1007	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0047	N/A	Room 1015	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0048	N/A	Room 1015	Water Fountain-No Chiller	Potable	4/23/2021	1.6	Result Below Action Level, Continue O&M
RUFSD-0049	N/A	Shared Bathroom in Room 1015 & Room 1013	Bathroom Faucet	Non-Potable	4/23/2021	6.2	Result Below Action Level, Continue O&M
RUFSD-0051	N/A	Room 1013	Classroom Faucet	Non-Potable	4/23/2021	3.1	Result Below Action Level, Continue O&M
RUFSD-0052	N/A	Room 1013	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0053	N/A	Room 1008	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0054	N/A	Room 1008	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0055	N/A	Shared Bathroom in Room 1008 & Room 1010	Bathroom Faucet	Non-Potable	4/23/2021	4.9	Result Below Action Level, Continue O&M
RUFSD-0057	N/A	Room 1010	Classroom Faucet	Non-Potable	4/23/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0058	N/A	Room 1010	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0059	N/A	Room 1012	Classroom Faucet	Non-Potable	4/23/2021	1.9	Result Below Action Level, Continue O&M
RUFSD-0060	N/A	Room 1012	Water Fountain-No Chiller	Potable	4/23/2021	1.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0061	N/A	Room 1012 Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	23	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0063	N/A	1st Floor Boys Gang Bathroom (Across From Cafeteria)	Bathroom Faucet	Non-Potable	4/23/2021	Sticker Replaced	
RUFSD-0064	N/A	1st Floor Boys Gang Bathroom (Across From Cafeteria)	Bathroom Faucet	Non-Potable	4/23/2021	Sticker Replaced	
RUFSD-0066	N/A	Gym Entrance Vestibule	Water Fountain-No Chiller	Potable	4/23/2021	1.3	Result Below Action Level, Continue O&M
RUFSD-0067	N/A	Gym Entrance Vestibule	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0068	N/A	1st Floor Girls Gang Bathroom (Across From Cafeteria)	Bathroom Faucet	Non-Potable	4/23/2021	6.8	Result Below Action Level, Continue O&M
RUFSD-0069	N/A	1st Floor Girls Gang Bathroom (Across From Cafeteria)	Bathroom Faucet	Non-Potable	4/23/2021	Sticker Replaced	
RUFSD-0071	N/A	1st Floor Corridor Storage 1073 to Staff Locker 1066A (Adjacent to Girl's Gang Bathroom)	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0072	N/A	1st Floor Corridor Storage 1073 to Staff Locker 1066A (Adjacent to Girl's Gang Bathroom)	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0073	N/A	Kitchen Serving Area	Hand Wash Only	Non-Potable	4/23/2021	6.1	Result Below Action Level, Continue O&M
RUFSD-0074	N/A	Kitchen Serving Area	Kitchen Faucet (Cold)	Potable	4/23/2021	2.3	Result Below Action Level, Continue O&M
RUFSD-0075	N/A	Kitchen	Ice Machine	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0076	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/23/2021	3.5	Result Below Action Level, Continue O&M
RUFSD-0077	N/A	Kitchen	Spray Nozzle	Non-Potable	4/23/2021	7.9	Result Below Action Level, Continue O&M
RUFSD-0078	N/A	Kitchen	Kitchen Faucet (Cold)	Non-Potable	4/23/2021	7.8	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0079	N/A	Kitchen	Kitchen Faucet (Cold)	Potable	4/23/2021	11	Result Below Action Level, Continue O&M
RUFSD-0080	N/A	Kitchen	Pasta Pot/Steam Kettle	Potable	4/23/2021	6.1	Result Below Action Level, Continue O&M
RUFSD-0081	N/A	Kitchen	Hand Wash Only	Non-Potable	4/23/2021	14	Result Below Action Level, Continue O&M
RUFSD-0082	N/A	Kitchen	Kitchen Faucet (Cold)	Potable	4/23/2021	5.1	Result Below Action Level, Continue O&M
RUFSD-0084	N/A	Faculty Dining 1058	Kitchen Faucet (Cold)	Non-Potable	4/23/2021	3.4	Result Below Action Level, Continue O&M
RUFSD-0085	N/A	Storage Closet in Faculty Dining 1058	Kitchen Non Potable	Non-Potable	4/23/2021	8.6	Result Below Action Level, Continue O&M
RUFSD-0086	N/A	Womens Staff Locker Room 1067A	Bathroom Faucet	Non-Potable	4/23/2021	3.6	Result Below Action Level, Continue O&M
RUFSD-0088	N/A	Mens Staff Locker Room 1066A	Bathroom Faucet	Non-Potable	4/23/2021	2.4	Result Below Action Level, Continue O&M
RUFSD-0090	N/A	Library Office (2nd Floor)	Hand Wash Only	Non-Potable	4/23/2021	95	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0091	N/A	Library Bathroom (2nd Floor)	Bathroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0093	N/A	Music Room 2032	Classroom Faucet	Non-Potable	4/23/2021	3.6	Result Below Action Level, Continue O&M
RUFSD-0094	N/A	Music Room 2032	Water Fountain-No Chiller	Potable	4/23/2021	1.2	Result Below Action Level, Continue O&M
RUFSD-0095	N/A	Room 2016	Classroom Faucet	Non-Potable	4/23/2021	3.4	Result Below Action Level, Continue O&M
RUFSD-0096	N/A	Room 2016	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0097	N/A	Room 2016 Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	7.6	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0099	N/A	2nd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	18	Placarded for Non-Drinking Use, Pending Remediation
RUFSD-0100	N/A	2nd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	6.1	Result Below Action Level, Continue O&M
RUFSD-0101	N/A	2nd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	5.5	Result Below Action Level, Continue O&M
RUFSD-0104	N/A	2nd Floor Corridor Room 2007 to Library (Adjacent to Science Room 2011)	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0105	N/A	2nd Floor Corridor Room 2007 to Library (Adjacent to Science Room 2011)	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0106	N/A	2nd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	Sticker Replaced	
RUFSD-0107	N/A	2nd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	8.0	Result Below Action Level, Continue O&M
RUFSD-0108	N/A	2nd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	Sticker Replaced	
RUFSD-0111	N/A	Room 2007	Classroom Faucet	Non-Potable	4/23/2021	3.9	Result Below Action Level, Continue O&M
RUFSD-0112	N/A	Room 2007	Water Fountain-No Chiller	Potable	4/23/2021	1.7	Result Below Action Level, Continue O&M
RUFSD-0113	N/A	Room 2007 Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	5.3	Result Below Action Level, Continue O&M
RUFSD-0115	N/A	Room 3007	Classroom Faucet	Non-Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0116	N/A	Room 3007	Water Fountain-No Chiller	Potable	4/23/2021	1.2	Result Below Action Level, Continue O&M
RUFSD-0117	N/A	Room 3007 Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	5.0	Result Below Action Level, Continue O&M
RUFSD-0119	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	4.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
RUFSD-0120	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	5.3	Result Below Action Level, Continue O&M
RUFSD-0121	N/A	3rd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	3.9	Result Below Action Level, Continue O&M
RUFSD-0123	N/A	3rd Floor Corridor Room 3007 to Stairs C (Adjacent to Faculty Lounge)	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0124	N/A	3rd Floor Corridor Room 3007 to Stairs C (Adjacent to Faculty Lounge)	Water Fountain-No Chiller	Potable	4/23/2021	<3.0 ND	Result Below Action Level, Continue O&M
RUFSD-0126	N/A	3rd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	8.4	Result Below Action Level, Continue O&M
RUFSD-0127	N/A	3rd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	3.6	Result Below Action Level, Continue O&M
RUFSD-0128	N/A	3rd Floor Girls Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	5.9	Result Below Action Level, Continue O&M
RUFSD-0130	N/A	3rd Floor Faculty Lounge	Kitchen Faucet (Cold)	Non-Potable	4/23/2021	5.9	Result Below Action Level, Continue O&M
RUFSD-0131	N/A	3rd Floor Faculty Lounge Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	3.3	Result Below Action Level, Continue O&M
RUFSD-0992	N/A	1st Floor Girls Gang Bathroom (Across From Cafeteria)	Bathroom Faucet	Non-Potable	4/23/2021	11	Result Below Action Level, Continue O&M
RUFSD-0993	N/A	1st Floor Boys Gang Bathroom (Across From Cafeteria)	Bathroom Faucet	Non-Potable	4/23/2021	5.5	Result Below Action Level, Continue O&M
RUFSD-0994	N/A	1st Floor Boys Gang Bathroom (Across From Cafeteria)	Bathroom Faucet	Non-Potable	4/23/2021	5.6	Result Below Action Level, Continue O&M
RUFSD-0995	N/A	2nd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	10	Result Below Action Level, Continue O&M
RUFSD-0996	N/A	2nd Floor Boys Gang Bathroom	Bathroom Faucet	Non-Potable	4/23/2021	9.1	Result Below Action Level, Continue O&M

Attachment 2:

Chain of Custody
&
Laboratory Analysis


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

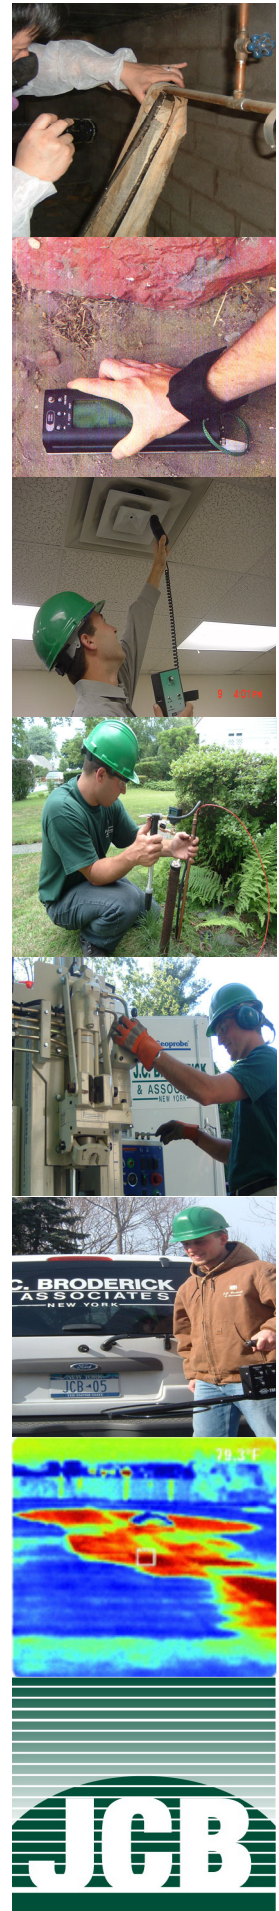



TEL: (631) 584-5492 FAX: (631) 584-3395

Building: Centennial Avenue Elementary School

Roosevelt Union Free School District

Turn Around: Normal 1 wk Rush

OrderID: 062107628

062107628

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0281	KI	N/A	Kitchen	KC	4/28/2021	5:29:00 AM
RUFSD-0282	KI	N/A	Kitchen	SN	4/28/2021	5:28:00 AM
RUFSD-0283	KI	N/A	Kitchen	KC	4/28/2021	5:28:00 AM
RUFSD-0284	KI	N/A	Kitchen	KC	4/28/2021	5:27:00 AM
RUFSD-0285	KI	N/A	Kitchen	IM	4/28/2021	5:31:00 AM
RUFSD-0286	KI	N/A	Kitchen	KC	4/28/2021	5:26:00 AM
RUFSD-0287	KI	N/A	Kitchen	PK	4/28/2021	5:26:00 AM
RUFSD-0288	KI	N/A	kitchen	KC	4/28/2021	5:24:00 AM
RUFSD-0289	KI	N/A	Kitchen	SN	4/28/2021	5:25:00 AM
RUFSD-0290	KI	N/A	Kitchen	HW	4/28/2021	5:30:00 AM
RUFSD-0291	KI	N/A	Kitchen Serving Area	HW	4/28/2021	5:33:00 AM
RUFSD-0292	KI	N/A	Kitchen Serving Area	KC	4/28/2021	5:33:00 AM
RUFSD-0293	FL	N/A	1st Floor Faculty Lounge	KC	4/28/2021	5:34:00 AM
RUFSD-0308	BR	N/A	Main Office Principal Bathroom	BF	4/28/2021	5:36:00 AM
RUFSD-0310	BR	N/A	Main Office Staff Bathroom	BF	4/28/2021	5:39:00 AM
RUFSD-0312	KI	N/A	Main Office Kitchenette	KC	4/28/2021	5:39:00 AM
RUFSD-0313	CR	N/A	Room 1004	CF	4/28/2021	5:42:00 AM
RUFSD-0314	CR	N/A	Room 1004	DW	4/28/2021	5:42:00 AM

Pb200.5 -

Signature:

JCB Project Manager: TARA RICKER

RECEIVED
ANALYTICAL INC
CARLE PLACE, ILL
3:30:00 AM
3:34:00 AM
3:34:00 AM
3:34:00 AM
3:39:00 AM
3:39:00 AM
3:42:00 AM

Page 1 of 5



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Centennial Avenue Elementary School
CAES

062107628

Client:

Roosevelt Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Page 2 of 5

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0315	BR	N/A	Shared Bathroom in Room 1004 & Room 1006	BF	4/28/2021	5:43:00 AM
RUFSD-0317	CR	N/A	Room 1006	CF	4/28/2021	5:40:00 AM
RUFSD-0318	CR	N/A	Room 1006	DW	4/28/2021	5:40:00 AM
RUFSD-0319	CR	N/A	Room 1007	CF	4/28/2021	5:44:00 AM
RUFSD-0320	CR	N/A	Room 1007	DW	4/28/2021	5:44:00 AM
RUFSD-0321	BR	N/A	Shared Bathroom in Room 1007 & Nurse's Office	BF	4/28/2021	5:49:00 AM
RUFSD-0323	NO	N/A	Nurse's Office (1008) Medication Room 1012	NS	4/28/2021	5:48:00 AM
RUFSD-0324	NO	N/A	Nurse's Office (1008) Exam Room 1011	NS	4/28/2021	5:48:00 AM
RUFSD-0325	CR	N/A	Room 1030	CF	4/28/2021	5:46:00 AM
RUFSD-0326	CR	N/A	Room 1030	DW	4/28/2021	5:46:00 AM
RUFSD-0327	BR	N/A	Shared Bathroom in Room 1030 & Room 1028	BF	4/28/2021	5:47:00 AM
RUFSD-0329	CR	N/A	Room 1028	CF	4/28/2021	5:51:00 AM
RUFSD-0330	CR	N/A	Room 1028	DW	4/28/2021	5:51:00 AM
RUFSD-0332	CR	N/A	Room 1026	CF	4/28/2021	5:53:00 AM
RUFSD-0333	CR	N/A	Room 1026	DW	4/28/2021	5:53:00 AM
RUFSD-0334	BR	N/A	Room 1026 Bathroom	BF	4/28/2021	5:54:00 AM
RUFSD-0338	CR	N/A	Room 1021	CF	4/28/2021	5:56:00 AM
RUFSD-0339	CR	N/A	Room 1021	DW	4/28/2021	5:56:00 AM

RECEIVED
JCB ANALYTICAL, INC.
CARLE PLACE
21 APR 28 PM 2:40

Building Address

140 W. Centennial Avenue
Roosevelt, NY 11575

Pb 200.5 -

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Sampler's Name: Alexandria Orlassino

Sampler's Signature: A Orlassino

JCB Project Manager: Tara Ricker

Order ID: 062107628



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Centennial Avenue Elementary School

CAES

06210 7628

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0340	BR	N/A	Shared Bathroom in Room 1021 & Room 1023	BF	4/28/2021	5:57:00 AM
RUFSD-0342	CR	N/A	Room 1023	CF	4/28/2021	5:58:00 AM
RUFSD-0343	CR	N/A	Room 1023	DW	4/28/2021	5:58:00 AM
RUFSD-0344	CR	N/A	Room 1042	CF	4/28/2021	5:59:00 AM
RUFSD-0345	CR	N/A	Room 1042	DW	4/28/2021	5:59:00 AM
RUFSD-0346	BR	N/A	Shared Bathroom in Room 1042 & Room 1045	BF	4/28/2021	6:01:00 AM
RUFSD-0348	CR	N/A	Room 1045	CF	4/28/2021	6:00:00 AM
RUFSD-0349	CR	N/A	Room 1045	DW	4/28/2021	6:00:00 AM
RUFSD-0350	FL	N/A	First Floor Café (Adjacent to Room 1045)	KC	4/28/2021	6:02:00 AM
RUFSD-0351	CR	N/A	Room 1048	CF	4/28/2021	6:04:00 AM
RUFSD-0352	CR	N/A	Room 1048	DW	4/28/2021	6:04:00 AM
RUFSD-0353	BR	N/A	Shared Bathroom in Room 1048 & Room 1050	BF	4/28/2021	6:05:00 AM
RUFSD-0355	CR	N/A	Room 1050	CF	4/28/2021	6:09:00 AM
RUFSD-0356	CR	N/A	Room 1050	DW	4/28/2021	6:09:00 AM
RUFSD-0357	CR	N/A	Room 1056	CF	4/28/2021	6:07:00 AM
RUFSD-0358	CR	N/A	Room 1056	DW	4/28/2021	6:07:00 AM
RUFSD-0359	BR	N/A	Shared Bathroom in Room 1056 & Room 1054	BF	4/28/2021	6:08:00 AM
RUFSD-0361	CR	N/A	Room 1054	CF	4/28/2021	6:11:00 AM

Building Address

140 W. Centennial Avenue Pb 200.5-

Roosevelt, NY 11575

Analysis Type: ELAP 200.5

Lab Received: *Ch*

Signature: *[Signature]*

Samplers Name: Alexandria Oriassino

Samplers Signature: A Oriassino

JCB Project Manager: Tara Ricker

Alger L... 05/03/21

RECEIVED
ENGLAND, NY
APR 28 2021
SAFE PLACE, NY



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Centennial Avenue Elementary School

CAES

062107628

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 4 of 5

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0362	CR	N/A	Room 1054	DW	4/28/2021	6:11:00 AM
RUFSD-0363	CR	N/A	Room 1052	CF	4/28/2021	6:13:00 AM
RUFSD-0364	CR	N/A	Room 1052	DW	4/28/2021	6:13:00 AM
RUFSD-0365	BR	N/A	Room 1052 Bathroom	BF	4/28/2021	6:14:00 AM
RUFSD-0367	CR	N/A	Music Room 2030	CF	4/28/2021	6:25:00 AM
RUFSD-0368	BR	N/A	Room 2028 Bathroom	BF	4/28/2021	6:24:00 AM
RUFSD-0370	CR	N/A	Room 2023	CF	4/28/2021	6:22:00 AM
RUFSD-0371	CR	N/A	Room 2023	DW	4/28/2021	6:22:00 AM
RUFSD-0372	BR	N/A	Room 2023 Bathroom	BF	4/28/2021	6:23:00 AM
RUFSD-0374	BR	N/A	2nd Floor Faculty Bathroom (Adjacent to Room 2020)	BF	4/28/2021	6:20:00 AM
RUFSD-0379	BR	N/A	2nd Floor Girls Gang Bathroom	BF	4/28/2021	6:18:00 AM
RUFSD-0380	BR	N/A	2nd Floor Girls Gang Bathroom	BF	4/28/2021	6:18:00 AM
RUFSD-0381	BR	N/A	2nd Floor Girls Gang Bathroom	BF	4/28/2021	6:19:00 AM
RUFSD-0383	BR	N/A	2nd Floor Boys Gang Bathroom	BF	4/28/2021	6:16:00 AM
RUFSD-0384	BR	N/A	2nd Floor Boys Gang Bathroom	BF	4/28/2021	6:17:00 AM
RUFSD-0385	BR	N/A	2nd Floor Boys Gang Bathroom	BF	4/28/2021	6:17:00 AM
RUFSD-0390	FL	N/A	3rd Floor Faculty Lounge	KC	4/28/2021	6:35:00 AM
RUFSD-0391	BR	N/A	3rd Floor Faculty Bathroom	BF	4/28/2021	6:36:00 AM

Building Address

140 W. Centennial Avenue

Roosevelt, NY 11575

P200.5 -

Ally L... 05/03/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Tara Ricker

RECEIVED
ENVIRONMENTAL, INC.
CARLE PLACE, NY
21 APR 28 PM 2:10

OrderID: 062107628



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Centennial Avenue Elementary School

CAES

062107628

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 5 of 5

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0393	CR	N/A	Room 3023	CF	4/28/2021	6:38:00 AM
RUFSD-0394	CR	N/A	Room 3023	DW	4/28/2021	6:38:00 AM
RUFSD-0395	BR	N/A	Room 3023 Bathroom	BF	4/28/2021	6:39:00 AM
RUFSD-0397	BR	N/A	Room 3020 Bathroom	BF	4/28/2021	6:40:00 AM
RUFSD-0399	SP	N/A	Art Room 3030	CF	4/28/2021	6:41:00 AM
RUFSD-0400	BR	N/A	3rd Floor Girls Gang Bathroom	BF	4/28/2021	6:34:00 AM
RUFSD-0401	BR	N/A	3rd Floor Girls Gang Bathroom	BF	4/28/2021	6:34:00 AM
RUFSD-0402	BR	N/A	3rd Floor Girls Gang Bathroom	BF	4/28/2021	6:35:00 AM
RUFSD-0404	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/28/2021	6:32:00 AM
RUFSD-0405	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/28/2021	6:32:00 AM
RUFSD-0406	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/28/2021	6:33:00 AM
RUFSD-0408	OF	N/A	Library Office (Closest to Bathroom)	HW	4/28/2021	6:28:00 AM

Samples Submitted 84

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 APR 28 PM 2:40

Building Address

140 W. Centennial Avenue
Roosevelt, NY 11575

96200.5 -
Myung 05/03/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino
Samplers Signature: A Orlassino
JCB Project Manager: Tara Ricker



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/12/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 4/28/2021. The results are tabulated on the attached data pages for the following client designated project:

19-45373, Centennial Avenue Elementary School, Roosevelt
Union Free School District, 140 W. Centennial Avenue,
Roosevelt, NY 11575

The reference number for these samples is EMSL Order #062107628. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description		RUFSD-0281	Collected:	4/28/2021	Lab ID:	062107628-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0282	Collected:	4/28/2021	Lab ID:	062107628-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0283	Collected:	4/28/2021	Lab ID:	062107628-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0284	Collected:	4/28/2021	Lab ID:	062107628-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0285	Collected:	4/28/2021	Lab ID:	062107628-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0286	Collected:	4/28/2021	Lab ID:	062107628-0006		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0287	Collected:	4/28/2021	Lab ID:	062107628-0007		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description		RUFSD-0288	Collected:	4/28/2021	Lab ID:	062107628-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0289	Collected:	4/28/2021	Lab ID:	062107628-0009		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0290	Collected:	4/28/2021	Lab ID:	062107628-0010		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0291	Collected:	4/28/2021	Lab ID:	062107628-0011		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0292	Collected:	4/28/2021	Lab ID:	062107628-0012		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0293	Collected:	4/28/2021	Lab ID:	062107628-0013		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0308	Collected:	4/28/2021	Lab ID:	062107628-0014		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	49	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0310	Collected:	4/28/2021	Lab ID:	062107628-0015		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description		RUFSD-0310	Collected:	4/28/2021	Lab ID:	062107628-0015		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0312	Collected:	4/28/2021	Lab ID:	062107628-0016		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0313	Collected:	4/28/2021	Lab ID:	062107628-0017		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0314	Collected:	4/28/2021	Lab ID:	062107628-0018		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0315	Collected:	4/28/2021	Lab ID:	062107628-0019		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0317	Collected:	4/28/2021	Lab ID:	062107628-0020		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0318	Collected:	4/28/2021	Lab ID:	062107628-0021		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hempstead, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description		RUFSD-0319	Collected:	4/28/2021	Lab ID:	062107628-0022		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.5	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0320	Collected:	4/28/2021	Lab ID:	062107628-0023		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0321	Collected:	4/28/2021	Lab ID:	062107628-0024		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	190	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0323	Collected:	4/28/2021	Lab ID:	062107628-0025		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0324	Collected:	4/28/2021	Lab ID:	062107628-0026		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0325	Collected:	4/28/2021	Lab ID:	062107628-0027		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0326	Collected:	4/28/2021	Lab ID:	062107628-0028		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0	µg/L	4/30/2021	AM	5/3/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description		RUFSD-0327	Collected:	4/28/2021	Lab ID:	062107628-0029		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0329	Collected:	4/28/2021	Lab ID:	062107628-0030		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0330	Collected:	4/28/2021	Lab ID:	062107628-0031		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		RUFSD-0332	Collected:	4/28/2021	Lab ID:	062107628-0032		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0333	Collected:	4/28/2021	Lab ID:	062107628-0033		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0334	Collected:	4/28/2021	Lab ID:	062107628-0034		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0338	Collected:	4/28/2021	Lab ID:	062107628-0035		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0339	Collected:	4/28/2021	Lab ID:	062107628-0036		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description RUFSD-0339 **Collected:** 4/28/2021 **Lab ID:** 062107628-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0340 **Collected:** 4/28/2021 **Lab ID:** 062107628-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0342 **Collected:** 4/28/2021 **Lab ID:** 062107628-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0343 **Collected:** 4/28/2021 **Lab ID:** 062107628-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0344 **Collected:** 4/28/2021 **Lab ID:** 062107628-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.7	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0345 **Collected:** 4/28/2021 **Lab ID:** 062107628-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0346 **Collected:** 4/28/2021 **Lab ID:** 062107628-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description		RUFSD-0348	Collected:	4/28/2021	Lab ID:	062107628-0043		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0349	Collected:	4/28/2021	Lab ID:	062107628-0044		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0350	Collected:	4/28/2021	Lab ID:	062107628-0045		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0351	Collected:	4/28/2021	Lab ID:	062107628-0046		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0352	Collected:	4/28/2021	Lab ID:	062107628-0047		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0353	Collected:	4/28/2021	Lab ID:	062107628-0048		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0355	Collected:	4/28/2021	Lab ID:	062107628-0049		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0	µg/L	4/30/2021	AM	5/3/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description		RUFSD-0356		Collected:	4/28/2021	Lab ID:	062107628-0050	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0357		Collected:	4/28/2021	Lab ID:	062107628-0051	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0358		Collected:	4/28/2021	Lab ID:	062107628-0052	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0359		Collected:	4/28/2021	Lab ID:	062107628-0053	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.7	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0361		Collected:	4/28/2021	Lab ID:	062107628-0054	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0362		Collected:	4/28/2021	Lab ID:	062107628-0055	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0363		Collected:	4/28/2021	Lab ID:	062107628-0056	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description RUFSD-0364 **Collected:** 4/28/2021 **Lab ID:** 062107628-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0365 **Collected:** 4/28/2021 **Lab ID:** 062107628-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0367 **Collected:** 4/28/2021 **Lab ID:** 062107628-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0368 **Collected:** 4/28/2021 **Lab ID:** 062107628-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0370 **Collected:** 4/28/2021 **Lab ID:** 062107628-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0371 **Collected:** 4/28/2021 **Lab ID:** 062107628-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0372 **Collected:** 4/28/2021 **Lab ID:** 062107628-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	22	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description RUFSD-0374 **Collected:** 4/28/2021 **Lab ID:** 062107628-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0379 **Collected:** 4/28/2021 **Lab ID:** 062107628-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0380 **Collected:** 4/28/2021 **Lab ID:** 062107628-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0381 **Collected:** 4/28/2021 **Lab ID:** 062107628-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0383 **Collected:** 4/28/2021 **Lab ID:** 062107628-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0384 **Collected:** 4/28/2021 **Lab ID:** 062107628-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0385 **Collected:** 4/28/2021 **Lab ID:** 062107628-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0390 **Collected:** 4/28/2021 **Lab ID:** 062107628-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description RUFSD-0390 **Collected:** 4/28/2021 **Lab ID:** 062107628-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0391 **Collected:** 4/28/2021 **Lab ID:** 062107628-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0393 **Collected:** 4/28/2021 **Lab ID:** 062107628-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0394 **Collected:** 4/28/2021 **Lab ID:** 062107628-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0395 **Collected:** 4/28/2021 **Lab ID:** 062107628-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.7	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0397 **Collected:** 4/28/2021 **Lab ID:** 062107628-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0399 **Collected:** 4/28/2021 **Lab ID:** 062107628-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/28/2021 02:40 PM
 Collected: 4/28/2021

Project: 19-45373, Centennial Avenue Elementary School, Roosevelt Union Free School District, 140 W. Centennial Avenue, Roosevelt< NY

Analytical Results

Client Sample Description RUFSD-0400 **Collected:** 4/28/2021 **Lab ID:** 062107628-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0401 **Collected:** 4/28/2021 **Lab ID:** 062107628-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0402 **Collected:** 4/28/2021 **Lab ID:** 062107628-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0404 **Collected:** 4/28/2021 **Lab ID:** 062107628-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.2	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0405 **Collected:** 4/28/2021 **Lab ID:** 062107628-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0406 **Collected:** 4/28/2021 **Lab ID:** 062107628-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0408 **Collected:** 4/28/2021 **Lab ID:** 062107628-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	4/30/2021	AM	5/3/2021	AL



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order:	062107628
CustomerID:	JCBR50
CustomerPO:	
ProjectID:	

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt HS

RH

0621 07886

Page 1 of 5

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0654	KI	N/A	Kitchen Serving Area	HW	4/30/2021	4:22:00 AM
RUFSD-0655	KI	N/A	Kitchen Serving Area	HW	4/30/2021	4:20:00 AM
RUFSD-0656	KI	N/A	Kitchen Serving Area	HW	4/30/2021	4:23:00 AM
RUFSD-0657	KI	N/A	Kitchen Serving Area	HW	4/30/2021	4:24:00 AM
RUFSD-0658	KI	N/A	Kitchen	HW	4/30/2021	4:26:00 AM
RUFSD-0659	KI	N/A	Kitchen	KC	4/30/2021	4:27:00 AM
RUFSD-0660	KI	N/A	Kitchen	SN	4/30/2021	4:28:00 AM
RUFSD-0661	KI	N/A	Kitchen	HW	4/30/2021	4:29:00 AM
RUFSD-0662	KI	N/A	Kitchen	KC	4/30/2021	4:29:00 AM
RUFSD-0663	KI	N/A	Kitchen	KC	4/30/2021	4:30:00 AM
RUFSD-0664	KI	N/A	Kitchen	KC	4/30/2021	4:30:00 AM
RUFSD-0665	KI	N/A	Kitchen	SN	4/30/2021	4:31:00 AM
RUFSD-0666	KI	N/A	Kitchen	IM	4/30/2021	4:25:00 AM
RUFSD-0667	KI	N/A	Kitchen	PK	4/30/2021	4:33:00 AM
RUFSD-0668	KI	N/A	Kitchen	KC	4/30/2021	4:32:00 AM
RUFSD-0672	KI	N/A	Culinary Arts Lab 135A	HW	4/30/2021	4:47:00 AM
RUFSD-0673	KI	N/A	Culinary Arts Lab 135A	KC	4/30/2021	4:36:00 AM
RUFSD-0674	KI	N/A	Culinary Arts Lab 135A	SN	4/30/2021	4:36:00 AM

Building Address

Roosevelt HS

Roosevelt, NY 11575

Pb 200.5
5/7/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Sampler's Name: Alexandria Orlassino

Sampler's Signature: A Orlassino

JCB Project Manager: Tara Ricker



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt HS

RH

0621 07886

Page 2 of 5

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0675	KI	N/A	Culinary Arts Lab 135A	KC	4/30/2021	4:35:00 AM
RUFSD-0676	KI	N/A	Culinary Arts Lab 135A	HW	4/30/2021	4:41:00 AM
RUFSD-0677	KI	N/A	Culinary Arts Lab 135A	KC	4/30/2021	4:38:00 AM
RUFSD-0678	KI	N/A	Culinary Arts Lab 135A	SN	4/30/2021	4:39:00 AM
RUFSD-0679	KI	N/A	Culinary Arts Lab 135A	KC	4/30/2021	4:37:00 AM
RUFSD-0680	KI	N/A	Culinary Arts Lab 135A	KC	4/30/2021	4:42:00 AM
RUFSD-0681	KI	N/A	Culinary Arts Lab 135A	KC	4/30/2021	4:42:00 AM
RUFSD-0682	KI	N/A	Culinary Arts Lab 135A	KC	4/30/2021	4:43:00 AM
RUFSD-0683	KI	N/A	Culinary Arts Lab 135A	SN	4/30/2021	4:44:00 AM
RUFSD-0684	KI	N/A	Culinary Arts Lab 135A	KC	4/30/2021	4:45:00 AM
RUFSD-0685	KI	N/A	Culinary Arts Lab 135A	PK	4/30/2021	4:45:00 AM
RUFSD-0686	CR	N/A	Boces Medical Assistant Lab 137B	CF	4/30/2021	4:50:00 AM
RUFSD-0687	CR	N/A	Boces Medical Assistant Lab 137B	CF	4/30/2021	4:50:00 AM
RUFSD-0688	CR	N/A	Boces Medical Assistant Lab 137B	CF	4/30/2021	4:51:00 AM
RUFSD-0689	CR	N/A	Boces Medical Assistant Lab 137B	CF	4/30/2021	4:51:00 AM
RUFSD-0690	CR	N/A	Boces Medical Assistant Lab 137B	CF	4/30/2021	4:52:00 AM
RUFSD-0702	HA	N/A	1st Floor Corridor C Room C165 to Room C151 (Across From Bathrooms)	WC	4/30/2021	5:37:00 AM
RUFSD-0703	HA	N/A	1st Floor Corridor C Room C165 to Room C151 (Across From Bathrooms)	WC	4/30/2021	5:38:00 AM

RECEIVED
EISL ANALYTICAL, INC.
LABORATORY
APR 30 2021 5:50 AM

Building Address

Roosevelt HS

Roosevelt, NY 11575

Pb 200.5 DO-761
5/7/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Tara Ricker



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt HS

RH

062107886

Client:

Roosevelt Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 3 of 5

OrderID: 062107886

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0750	HA	N/A	1st Floor Corridor B Room B147 to Room B142 (Adjacent to Girl's Gang Bathroom)	WC	4/30/2021	5:42:00 AM
RUFSD-0751	HA	N/A	1st Floor Corridor B Room B147 to Room B142 (Adjacent to Girl's Gang Bathroom)	WC	4/30/2021	5:42:00 AM
RUFSD-0804	HA	N/A	1st Floor Corridor Girl's Locker Room to Boy's Locker Room (Inside Exit Vestibule)	WF	4/30/2021	5:33:00 AM
RUFSD-0805	HA	N/A	1st Floor Corridor Girl's Locker Room to Boy's Locker Room (Inside Exit Vestibule)	WC	4/30/2021	5:34:00 AM
RUFSD-0806	HA	N/A	1st Floor Corridor Girl's Locker Room to Boy's Locker Room (Inside Exit Vestibule)	WC	4/30/2021	5:34:00 AM
RUFSD-0811	GY	N/A	Fitness Center 036	WF	4/30/2021	5:30:00 AM
RUFSD-0812	GY	N/A	Fitness Center 036	WC	4/30/2021	5:31:00 AM
RUFSD-0813	GY	N/A	Fitness Center 036	WC	4/30/2021	5:31:00 AM
RUFSD-0816	CR	N/A	JROTC Room 034	CF	4/30/2021	5:28:00 AM
RUFSD-0826	HA	N/A	1st Floor Corridor Athletic Director Office to Kitchen (Adjacent to Office 032)	WF	4/30/2021	5:26:00 AM
RUFSD-0827	HA	N/A	1st Floor Corridor Athletic Director Office to Kitchen (Adjacent to Office 032)	WC	4/30/2021	5:26:00 AM
RUFSD-0828	HA	N/A	1st Floor Corridor Athletic Director Office to Kitchen (Adjacent to Office 032)	WC	4/30/2021	5:27:00 AM
RUFSD-0836	HA	N/A	1st Floor Corridor Library to Cafeteria (Across From Rooms 016 & 014)	WC	4/30/2021	5:48:00 AM
RUFSD-0837	HA	N/A	1st Floor Corridor Library to Cafeteria (Across From Rooms 016 & 014)	WC	4/30/2021	5:49:00 AM
RUFSD-0849	OF	N/A	Library Office 011E	HW	4/30/2021	5:04:00 AM
RUFSD-0852	NO	N/A	Nurse's Office	NS	4/30/2021	5:08:00 AM
RUFSD-0857	KI	N/A	Main Office 010 Kitchenette	KC	4/30/2021	5:06:00 AM
RUFSD-0858	KI	N/A	Main Office 010 Kitchenette	BW	4/30/2021	5:07:00 AM

Building Address

Roosevelt HS

Roosevelt, NY 11575

Pb 200.5 DO *JCB*
5/7/21

Analysis Type: ELAP 200.5

Lab Received: *[Signature]*

Signature: *[Signature]*

Samplers Name: Alexandria Oriassino

Samplers Signature: A Oriassino

JCB Project Manager: Tara Ricker

RECEIVED
HSH ANALYTICAL, INC.
218
3
APR 30 2021
CITY OF PLACER, CA



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt HS

RH

062107886

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 4 of 5

OrderID: 062107886

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0859	KI	N/A	Main Office 010 Kitchenette	BW	4/30/2021	5:07:00 AM
RUFSD-0862	OF	N/A	Health Clinic 051 Nurse Practitioner's Office	HW	4/30/2021	5:13:00 AM
RUFSD-0863	NO	N/A	Health Clinic 051 Examination Room	NS	4/30/2021	5:15:00 AM
RUFSD-0874	OF	N/A	Office 054	BW	4/30/2021	5:16:00 AM
RUFSD-0875	OF	N/A	Office 054	BW	4/30/2021	5:17:00 AM
RUFSD-0876	FL	N/A	Staff Room 062	KC	4/30/2021	5:18:00 AM
RUFSD-0877	OF	N/A	Human Resources Office 066	BW	4/30/2021	5:20:00 AM
RUFSD-0878	OF	N/A	Human Resources Office 066	BW	4/30/2021	5:20:00 AM
RUFSD-0880	OF	N/A	Business Office 057	BW	4/30/2021	5:21:00 AM
RUFSD-0904	OF	N/A	Corridor A Administration Room A110	BW	4/30/2021	5:01:00 AM
RUFSD-0905	OF	N/A	Corridor A Administration Room A110	BW	4/30/2021	5:00:00 AM
RUFSD-0908	HA	N/A	1st Floor Corridor A Room A109 to Room A115 (Adjacent to Room A109)	WC	4/30/2021	5:44:00 AM
RUFSD-0909	HA	N/A	1st Floor Corridor A Room A109 to Room A115 (Adjacent to Room A109)	WC	4/30/2021	5:45:00 AM
RUFSD-0918	HA	N/A	2nd Floor Corridor A Room 200 to Room 215 (Across From Room A200)	WC	4/30/2021	5:55:00 AM
RUFSD-0919	HA	N/A	2nd Floor Corridor A Room 200 to Room 215 (Across From Room A200)	WC	4/30/2021	5:55:00 AM
RUFSD-0933	HE	N/A	Life Skills Room A216	EC	4/30/2021	5:58:00 AM
RUFSD-0942	FL	N/A	2nd Floor Faculty Lounge B239	KC	4/30/2021	6:04:00 AM
RUFSD-0977	HA	N/A	2nd Floor Corridor C Room C268 to Room C250 (Adjacent to Room C259)	WC	4/30/2021	6:02:00 AM

Building Address

Roosevelt HS

Roosevelt, NY 11575

Pb 200.5 DO-76
5/7/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Tara Ricker

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
4/30/21 11:58 AM



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt HS

RH

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0978	HA	N/A	2nd Floor Corridor C Room C268 to Room C250 (Adjacent to Room C259)	WC	4/30/2021	6:02:00 AM
RUFSD-1014	OF	N/A	Nurse's Office Exam Room 015B	BW	4/30/2021	5:11:00 AM
RUFSD-1015	OF	N/A	Nurse's Office Exam Room 015B	BW	4/30/2021	5:10:00 AM

Samples Submitted 75

062107886

RECEIVED
EHS ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY - 3 AM 11:57

Building Address

Roosevelt HS

Roosevelt, NY 11575

Pb 200.5 DO

5/7/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: TARA RICKER



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/12/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/3/2021. The results are tabulated on the attached data pages for the following client designated project:

**19-45373, Roosevelt HS, Roosevelt Union Free School District,
Roosevelt HS, Roosevelt, NY 11575**

The reference number for these samples is EMSL Order #062107886. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0654 **Collected:** 4/30/2021 **Lab ID:** 062107886-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	5/6/2021	AM	5/7/2021	DI
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0655 **Collected:** 4/30/2021 **Lab ID:** 062107886-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0656 **Collected:** 4/30/2021 **Lab ID:** 062107886-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0657 **Collected:** 4/30/2021 **Lab ID:** 062107886-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0658 **Collected:** 4/30/2021 **Lab ID:** 062107886-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.6	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0659 **Collected:** 4/30/2021 **Lab ID:** 062107886-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0660 **Collected:** 4/30/2021 **Lab ID:** 062107886-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0661 **Collected:** 4/30/2021 **Lab ID:** 062107886-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0661 **Collected:** 4/30/2021 **Lab ID:** 062107886-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0662 **Collected:** 4/30/2021 **Lab ID:** 062107886-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0663 **Collected:** 4/30/2021 **Lab ID:** 062107886-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0664 **Collected:** 4/30/2021 **Lab ID:** 062107886-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0665 **Collected:** 4/30/2021 **Lab ID:** 062107886-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0666 **Collected:** 4/30/2021 **Lab ID:** 062107886-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0667 **Collected:** 4/30/2021 **Lab ID:** 062107886-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0668 **Collected:** 4/30/2021 **Lab ID:** 062107886-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0668		Collected:	4/30/2021	Lab ID:	062107886-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0672		Collected:	4/30/2021	Lab ID:	062107886-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0673		Collected:	4/30/2021	Lab ID:	062107886-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	31	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0674		Collected:	4/30/2021	Lab ID:	062107886-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0675		Collected:	4/30/2021	Lab ID:	062107886-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0676		Collected:	4/30/2021	Lab ID:	062107886-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0677		Collected:	4/30/2021	Lab ID:	062107886-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.7	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0678		Collected:	4/30/2021	Lab ID:	062107886-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0678		Collected:	4/30/2021	Lab ID:	062107886-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0679		Collected:	4/30/2021	Lab ID:	062107886-0023	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0680		Collected:	4/30/2021	Lab ID:	062107886-0024	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0681		Collected:	4/30/2021	Lab ID:	062107886-0025	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0682		Collected:	4/30/2021	Lab ID:	062107886-0026	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0683		Collected:	4/30/2021	Lab ID:	062107886-0027	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0684		Collected:	4/30/2021	Lab ID:	062107886-0028	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0685		Collected:	4/30/2021	Lab ID:	062107886-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0685		Collected:	4/30/2021	Lab ID:	062107886-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0686		Collected:	4/30/2021	Lab ID:	062107886-0030	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0687		Collected:	4/30/2021	Lab ID:	062107886-0031	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0688		Collected:	4/30/2021	Lab ID:	062107886-0032	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0689		Collected:	4/30/2021	Lab ID:	062107886-0033	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0690		Collected:	4/30/2021	Lab ID:	062107886-0034	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0702		Collected:	4/30/2021	Lab ID:	062107886-0035	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0703		Collected:	4/30/2021	Lab ID:	062107886-0036	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0703 **Collected:** 4/30/2021 **Lab ID:** 062107886-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0750 **Collected:** 4/30/2021 **Lab ID:** 062107886-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0751 **Collected:** 4/30/2021 **Lab ID:** 062107886-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0804 **Collected:** 4/30/2021 **Lab ID:** 062107886-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0805 **Collected:** 4/30/2021 **Lab ID:** 062107886-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0806 **Collected:** 4/30/2021 **Lab ID:** 062107886-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0811 **Collected:** 4/30/2021 **Lab ID:** 062107886-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0812 **Collected:** 4/30/2021 **Lab ID:** 062107886-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0812 **Collected:** 4/30/2021 **Lab ID:** 062107886-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0813 **Collected:** 4/30/2021 **Lab ID:** 062107886-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0816 **Collected:** 4/30/2021 **Lab ID:** 062107886-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0826 **Collected:** 4/30/2021 **Lab ID:** 062107886-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0827 **Collected:** 4/30/2021 **Lab ID:** 062107886-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0828 **Collected:** 4/30/2021 **Lab ID:** 062107886-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0836 **Collected:** 4/30/2021 **Lab ID:** 062107886-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0837 **Collected:** 4/30/2021 **Lab ID:** 062107886-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0837 **Collected:** 4/30/2021 **Lab ID:** 062107886-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0849 **Collected:** 4/30/2021 **Lab ID:** 062107886-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0852 **Collected:** 4/30/2021 **Lab ID:** 062107886-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0857 **Collected:** 4/30/2021 **Lab ID:** 062107886-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0858 **Collected:** 4/30/2021 **Lab ID:** 062107886-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0859 **Collected:** 4/30/2021 **Lab ID:** 062107886-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0862 **Collected:** 4/30/2021 **Lab ID:** 062107886-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0863 **Collected:** 4/30/2021 **Lab ID:** 062107886-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0863 **Collected:** 4/30/2021 **Lab ID:** 062107886-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.1	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0874 **Collected:** 4/30/2021 **Lab ID:** 062107886-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0875 **Collected:** 4/30/2021 **Lab ID:** 062107886-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0876 **Collected:** 4/30/2021 **Lab ID:** 062107886-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0877 **Collected:** 4/30/2021 **Lab ID:** 062107886-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0878 **Collected:** 4/30/2021 **Lab ID:** 062107886-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0880 **Collected:** 4/30/2021 **Lab ID:** 062107886-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0904 **Collected:** 4/30/2021 **Lab ID:** 062107886-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0904		Collected:	4/30/2021	Lab ID:	062107886-0064	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0905		Collected:	4/30/2021	Lab ID:	062107886-0065	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0908		Collected:	4/30/2021	Lab ID:	062107886-0066	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Client Sample Description		RUFSD-0909		Collected:	4/30/2021	Lab ID:	062107886-0067	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0918		Collected:	4/30/2021	Lab ID:	062107886-0068	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0919		Collected:	4/30/2021	Lab ID:	062107886-0069	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	5/6/2021	AM	5/7/2021	DI
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0933		Collected:	4/30/2021	Lab ID:	062107886-0070	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/6/2021	AM	5/7/2021	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107886

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 5/3/2021 11:58 AM
 Collected: 4/30/2021

Project: 19-45373, Roosevelt HS, Roosevelt Union Free School District, Roosevelt HS, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0942 **Collected:** 4/30/2021 **Lab ID:** 062107886-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0977 **Collected:** 4/30/2021 **Lab ID:** 062107886-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-0978 **Collected:** 4/30/2021 **Lab ID:** 062107886-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-1014 **Collected:** 4/30/2021 **Lab ID:** 062107886-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Client Sample Description RUFSD-1015 **Collected:** 4/30/2021 **Lab ID:** 062107886-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/6/2021	AM	5/7/2021	DI

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt Middle School

RMS

062107882

Page 1 of 7

Client:

Roosevelt Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0420	KI	N/A	Kitchen Serving Area	HW	4/29/2021	4:24:00 AM
RUFSD-0421	KI	N/A	Kitchen Serving Area	KC	4/29/2021	4:25:00 AM
RUFSD-0422	KI	N/A	Kitchen Serving Area	KC	4/29/2021	4:25:00 AM
RUFSD-0423	KI	N/A	Snack Bar Room 1440B	HW	4/29/2021	4:20:00 AM
RUFSD-0424	KI	N/A	Kitchen	IM	4/29/2021	4:22:00 AM
RUFSD-0425	KI	N/A	Kitchen	KC	4/29/2021	4:17:00 AM
RUFSD-0426	KI	N/A	Kitchen	KC	4/29/2021	4:16:00 AM
RUFSD-0427	KI	N/A	Kitchen	KC	4/29/2021	4:16:00 AM
RUFSD-0428	KI	N/A	Kitchen	HW	4/29/2021	4:15:00 AM
RUFSD-0429	KI	N/A	Kitchen	SN	4/29/2021	4:12:00 AM
RUFSD-0430	KI	N/A	Kitchen	KC	4/29/2021	4:18:00 AM
RUFSD-0431	KI	N/A	Kitchen	PK	4/29/2021	4:19:00 AM
RUFSD-0433	CA	N/A	Cafeteria	WC	4/29/2021	4:26:00 AM
RUFSD-0434	FL	N/A	Staff Room 1420	KC	4/29/2021	5:02:00 AM
RUFSD-0435	BR	N/A	Male Staff Locker Room	BF	4/29/2021	5:04:00 AM
RUFSD-0437	BR	N/A	Female Staff Locker Room	BF	4/29/2021	5:03:00 AM
RUFSD-0439	CR	N/A	Music Room 1403	CF	4/29/2021	4:49:00 AM
RUFSD-0440	CR	N/A	Music Room 1403	DW	4/29/2021	5:00:00 AM

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
APR 29 2021 3:25 PM

Building Address

335 E. Clinton Avenue

Roosevelt, NY 11575

Pb 200.5

A. Jung 05/10/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Oriassino

Samplers Signature: A Oriassino

JCB Project Manager: Tara Ricker



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt Middle School

RMS

062107882

Client

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0441	CR	N/A	Music Room 1403	DW	4/29/2021	5:00:00 AM
RUFSD-0442	FL	N/A	Faculty Lounge in Cafeteria	KC	4/29/2021	4:27:00 AM
RUFSD-0443	BR	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:32:00 AM
RUFSD-0444	BR	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:32:00 AM
RUFSD-0445	BR	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:33:00 AM
RUFSD-0446	BR	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:33:00 AM
RUFSD-0447	BR	N/A	1st Floor Girls Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:34:00 AM
RUFSD-0450	BR	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:37:00 AM
RUFSD-0451	BR	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:37:00 AM
RUFSD-0452	BR	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:38:00 AM
RUFSD-0453	BR	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:38:00 AM
RUFSD-0454	BR	N/A	1st Floor Boys Gang Bathroom (Across From Main Office)	BF	4/29/2021	4:39:00 AM
RUFSD-0456	BR	N/A	Boys Coach's Office 1206 Bathroom	BF	4/29/2021	4:52:00 AM
RUFSD-0459	BR	N/A	Boys Locker Room Bathroom	BF	4/29/2021	4:55:00 AM
RUFSD-0460	BR	N/A	Boys Locker Room Bathroom	BF	4/29/2021	4:56:00 AM
RUFSD-0462	BR	N/A	Girls Locker Room Bathroom	BF	4/29/2021	4:44:00 AM
RUFSD-0463	BR	N/A	Girls Locker Room Bathroom	BF	4/29/2021	4:45:00 AM
RUFSD-0466	BR	N/A	Girls Coach's Office 1219 Bathroom	BF	4/29/2021	4:42:00 AM

Building Address
335 E. Clinton Avenue
Roosevelt, NY 11575

Pb200.5 -

A. Long 05/10/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: *A. Orlassino*

JCB Project Manager: Tara Ricker

RECEIVED
EPA ANALYTICAL, INC.
SAMPLE RECEIVED
APR 29 2021 4:52 PM



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373
Building: Roosevelt Middle School

RMS

062107882

Client: Roosevelt Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Page 3 of 7

Order ID: 062107882

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0468	BR	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:50:00 AM
RUFSD-0469	BR	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:51:00 AM
RUFSD-0470	BR	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:51:00 AM
RUFSD-0471	BR	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:52:00 AM
RUFSD-0472	BR	N/A	1st Floor Boys Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:52:00 AM
RUFSD-0475	BR	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:47:00 AM
RUFSD-0476	BR	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:47:00 AM
RUFSD-0477	BR	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:49:00 AM
RUFSD-0478	BR	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:48:00 AM
RUFSD-0479	BR	N/A	1st Floor Girls Gang Bathroom (Adjacent to Gym Entrance)	BF	4/29/2021	4:48:00 AM
RUFSD-0482	BR	N/A	Main Office Principal Bathroom	BF	4/29/2021	4:32:00 AM
RUFSD-0484	BR	N/A	Main Office Staff Bathroom	BF	4/29/2021	4:30:00 AM
RUFSD-0486	KI	N/A	Main Office Kitchenette	KC	4/29/2021	4:28:00 AM
RUFSD-0487	KI	N/A	Main Office Kitchenette	BW	4/29/2021	4:29:00 AM
RUFSD-0488	KI	N/A	Main Office Kitchenette	BW	4/29/2021	4:29:00 AM
RUFSD-0489	KI	N/A	PPS Offices Kitchenette	KC	4/29/2021	5:08:00 AM
RUFSD-0490	KI	N/A	PPS Offices Kitchenette	BW	4/29/2021	5:08:00 AM
RUFSD-0491	KI	N/A	PPS Offices Kitchenette	BW	4/29/2021	5:09:00 AM

RECEIVED
FMSI ANALYTICAL, INC.
CAPILLARY
21 APR 29 PM 3:28
PLACE IN

Building Address
335 E. Clinton Avenue
Roosevelt, NY 11575

Pb 200.5 -

A. Lung 05/10/21

Analysis Type: ELAP 200.5

Lab Received: *[Signature]*

Signature: *[Signature]*

Samplers Name: Alexandria Orlassino

Samplers Signature: *A. Orlassino*

JCB Project Manager: Tara Ricker



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt Middle School

RMS

062107882

Client:

Roosevelt Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 4 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0492	BR	N/A	PPS Bathroom (Across From Room 1016)	BF	4/29/2021	5:10:00 AM
RUFSD-0494	BR	N/A	Nurse's Office Bathroom	BF	4/29/2021	5:13:00 AM
RUFSD-0496	NO	N/A	Nurse's Office Exam Room 1310	NS	4/29/2021	5:13:00 AM
RUFSD-0497	NO	N/A	Nurse's Office Exam Room 1310	BW	4/29/2021	5:14:00 AM
RUFSD-0498	NO	N/A	Nurse's Office Exam Room 1310	BW	4/29/2021	5:14:00 AM
RUFSD-0499	HA	N/A	1st Floor Corridor PPS Offices to Room 1347 (Across Room 1322)	DW	4/29/2021	5:18:00 AM
RUFSD-0500	HA	N/A	1st Floor Corridor PPS Offices to Room 1347 (Across Room 1322)	DW	4/29/2021	5:18:00 AM
RUFSD-0501	HA	N/A	1st Floor Corridor PPS Offices to Room 1347 (Across Room 1322)	DW	4/29/2021	5:19:00 AM
RUFSD-0502	HA	N/A	1st Floor Corridor PPS Offices to Room 1347 (Across Room 1322)	DW	4/29/2021	5:19:00 AM
RUFSD-0503	BR	N/A	1st Floor Boys Gang Bathroom (Adjacent to Custodial Closet 1333)	BF	4/29/2021	5:20:00 AM
RUFSD-0504	BR	N/A	1st Floor Boys Gang Bathroom (Adjacent to Custodial Closet 1333)	BF	4/29/2021	5:21:00 AM
RUFSD-0505	BR	N/A	1st Floor Boys Gang Bathroom (Adjacent to Custodial Closet 1333)	BF	4/29/2021	5:21:00 AM
RUFSD-0508	BR	N/A	1st Floor Girls Gang Bathroom (Adjacent to Custodial Closet 1333)	BF	4/29/2021	5:22:00 AM
RUFSD-0509	BR	N/A	1st Floor Girls Gang Bathroom (Adjacent to Custodial Closet 1333)	BF	4/29/2021	5:22:00 AM
RUFSD-0510	BR	N/A	1st Floor Girls Gang Bathroom (Adjacent to Custodial Closet 1333)	BF	4/29/2021	5:23:00 AM
RUFSD-0512	BR	N/A	Room 1337 Bathroom	BF	4/29/2021	5:25:00 AM
RUFSD-0514	FL	N/A	1st Floor Faculty Lounge 1347	KC	4/29/2021	5:26:00 AM
RUFSD-0515	BR	N/A	1st Floor Faculty Lounge 1347 Bathroom	BF	4/29/2021	5:26:00 AM

RECEIVED
LMS - ANALYTICAL, INC.
CARLE PLACE, NY
21 APR 29 PM 3:25

Building Address

335 E. Clinton Avenue

Roosevelt, NY 11575

Pb200.5 -

A. Long 05/10/21

Analysis Type: ELAP 200.5

Lab Received: *oh*

Signature: *[Signature]*

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Tara Kicker

OrderID: 062107882



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt Middle School

RMS

062107882

Client:

Roosevelt Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 5 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0517	KI	N/A	3rd Floor Kitchenette (Mail/Copy 3005)	KC	4/29/2021	6:00:00 AM
RUFSD-0518	BR	N/A	3rd Floor Principal Office Bathroom	BF	4/29/2021	6:00:00 AM
RUFSD-0554	HA	N/A	3rd Floor Corridor Room 3305 to Room 3340 (Across Room 3319)	DW	4/29/2021	6:01:00 AM
RUFSD-0555	HA	N/A	3rd Floor Corridor Room 3305 to Room 3340 (Across Room 3319)	DW	4/29/2021	6:02:00 AM
RUFSD-0556	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/29/2021	6:03:00 AM
RUFSD-0557	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/29/2021	6:04:00 AM
RUFSD-0558	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/29/2021	6:04:00 AM
RUFSD-0561	BR	N/A	3rd Floor Girls Gang Bathroom	BF	4/29/2021	6:05:00 AM
RUFSD-0562	BR	N/A	3rd Floor Girls Gang Bathroom	BF	4/29/2021	6:05:00 AM
RUFSD-0563	BR	N/A	3rd Floor Girls Gang Bathroom	BF	4/29/2021	6:06:00 AM
RUFSD-0565	BR	N/A	Room 3330 Bathroom	BF	4/29/2021	6:07:00 AM
RUFSD-0567	FL	N/A	3rd Floor Faculty Lounge 3340	KC	4/29/2021	6:08:00 AM
RUFSD-0568	BR	N/A	3rd Floor Faculty Lounge 3340 Bathroom	BF	4/29/2021	6:09:00 AM
RUFSD-0570	FL	N/A	2nd Floor Faculty Lounge 2340	KC	4/29/2021	5:56:00 AM
RUFSD-0571	BR	N/A	2nd Floor Faculty Lounge 2340 Bathroom	BF	4/29/2021	5:56:00 AM
RUFSD-0573	BR	N/A	Room 2330 Bathroom	BF	4/29/2021	5:56:00 AM
RUFSD-0575	BR	N/A	2nd Floor Girls Gang Bathroom	BF	4/29/2021	5:53:00 AM
RUFSD-0576	BR	N/A	2nd Floor Girls Gang Bathroom	BF	4/29/2021	5:54:00 AM

Building Address

335 E. Clinton Avenue

Roosevelt, NY 11575

PB200.5 -

A. Lunny 05/10/21

Analysis Type: ELAP 200.5

Lab Received: *Chaele*

Signature: *[Signature]*

Samplers Name: Alexandria Orlassino

Samplers Signature: A. Orlassino

JCB Project Manager: Tara Ricker

OrderID: 062107882

RECEIVED
ENVIRONMENTAL
CARLE PLACE
APR 29 2021
PH 3526



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373
Building: Roosevelt Middle School
RMS

062107882

Client: Roosevelt Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Page 6 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0577	BR	N/A	2nd Floor Girls Gang Bathroom	BF	4/29/2021	5:54:00 AM
RUFSD-0580	BR	N/A	2nd Floor Boys Gang Bathroom	BF	4/29/2021	5:50:00 AM
RUFSD-0581	BR	N/A	2nd Floor Boys Gang Bathroom	BF	4/29/2021	5:51:00 AM
RUFSD-0582	BR	N/A	2nd Floor Boys Gang Bathroom	BF	4/29/2021	5:51:00 AM
RUFSD-0618	HA	N/A	2nd Floor Corridor Room 2305 to Room 2340 (Across Room 2319)	DW	4/29/2021	5:49:00 AM
RUFSD-0619	HA	N/A	2nd Floor Corridor Room 2305 to Room 2340 (Across Room 2319)	DW	4/29/2021	5:49:00 AM
RUFSD-0620	KI	N/A	2nd Floor Kitchenette (Mail/Copy 2004)	KC	4/29/2021	5:46:00 AM
RUFSD-0621	BR	N/A	Office 2004 Bathroom	BF	4/29/2021	5:47:00 AM
RUFSD-0623	OF	N/A	Library Office 2108	HW	4/29/2021	5:45:00 AM
RUFSD-0630	BR	N/A	2nd Floor Art Room Wing Boys Bathroom	BF	4/29/2021	5:33:00 AM
RUFSD-0631	BR	N/A	2nd Floor Art Room Wing Boys Bathroom	BF	4/29/2021	5:34:00 AM
RUFSD-0632	BR	N/A	2nd Floor Art Room Wing Boys Bathroom	BF	4/29/2021	5:34:00 AM
RUFSD-0634	BR	N/A	2nd Floor Art Room Wing Girls Bathroom	BF	4/29/2021	5:31:00 AM
RUFSD-0635	BR	N/A	2nd Floor Art Room Wing Girls Bathroom	BF	4/29/2021	5:31:00 AM
RUFSD-0636	BR	N/A	2nd Floor Art Room Wing Girls Bathroom	BF	4/29/2021	5:32:00 AM
RUFSD-0640	HE	N/A	Home Economics Room 2422	EC	4/29/2021	5:36:00 AM
RUFSD-0641	HE	N/A	Home Economics Room 2422	EC	4/29/2021	5:37:00 AM
RUFSD-0642	HE	N/A	Home Economics Room 2422	EC	4/29/2021	5:38:00 AM

RECEIVED
ENVIRONMENTAL ANALYTICAL INC.
CARLE P. AOCHE
2 APR 29 PM 1:35

Building Address
335 E. Clinton Avenue
Roosevelt, NY 11575

FB200.5 -
A. Long 05/10/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A. Orlassino

JCB Project Manager: Tara Ricker

OrderID: 062107882



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Roosevelt Middle School

RMS

062107882

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 7 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0643	HE	N/A	Home Economics Room 2422	EC	4/29/2021	5:39:00 AM
RUFSD-0644	HE	N/A	Home Economics Room 2422	EC	4/29/2021	5:39:00 AM
RUFSD-0647	HE	N/A	Home Economics Room 2424	EC	4/29/2021	5:40:00 AM
RUFSD-0648	HE	N/A	Home Economics Room 2424	EC	4/29/2021	5:41:00 AM
RUFSD-0649	HE	N/A	Home Economics Room 2424	EC	4/29/2021	5:41:00 AM
RUFSD-0650	HE	N/A	Home Economics Room 2424	EC	4/29/2021	5:42:00 AM
RUFSD-0651	HE	N/A	Home Economics Room 2424	EC	4/29/2021	5:42:00 AM
RUFSD-0998	KI	N/A	Kitchen	HW	4/29/2021	4:14:00 AM

Samples Submitted 116

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 APR 29 PM 3:26

Building Address

335 E. Clinton Avenue

Roosevelt, NY 11575

Pb 2005 -
A. Luang 05/10/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Tara Ricker



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/12/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 4/29/2021. The results are tabulated on the attached data pages for the following client designated project:

**19-45373, Roosevelt Middle School, Roosevelt Union Free
School District, 335 E. Clinton Avenue, Roosevelt, NY 11575**

The reference number for these samples is EMSL Order #062107882. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0420 **Collected:** 4/29/2021 **Lab ID:** 062107882-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0421 **Collected:** 4/29/2021 **Lab ID:** 062107882-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0422 **Collected:** 4/29/2021 **Lab ID:** 062107882-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0423 **Collected:** 4/29/2021 **Lab ID:** 062107882-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0424 **Collected:** 4/29/2021 **Lab ID:** 062107882-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0425 **Collected:** 4/29/2021 **Lab ID:** 062107882-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0426 **Collected:** 4/29/2021 **Lab ID:** 062107882-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0427 **Collected:** 4/29/2021 **Lab ID:** 062107882-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0428 **Collected:** 4/29/2021 **Lab ID:** 062107882-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0429 **Collected:** 4/29/2021 **Lab ID:** 062107882-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0430 **Collected:** 4/29/2021 **Lab ID:** 062107882-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0431 **Collected:** 4/29/2021 **Lab ID:** 062107882-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0433 **Collected:** 4/29/2021 **Lab ID:** 062107882-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0434 **Collected:** 4/29/2021 **Lab ID:** 062107882-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0435 **Collected:** 4/29/2021 **Lab ID:** 062107882-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	25	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0437 **Collected:** 4/29/2021 **Lab ID:** 062107882-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.9	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0439 **Collected:** 4/29/2021 **Lab ID:** 062107882-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0440 **Collected:** 4/29/2021 **Lab ID:** 062107882-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0441 **Collected:** 4/29/2021 **Lab ID:** 062107882-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0442 **Collected:** 4/29/2021 **Lab ID:** 062107882-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.0	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0443 **Collected:** 4/29/2021 **Lab ID:** 062107882-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0444 **Collected:** 4/29/2021 **Lab ID:** 062107882-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0444 **Collected:** 4/29/2021 **Lab ID:** 062107882-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0445 **Collected:** 4/29/2021 **Lab ID:** 062107882-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.8	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0446 **Collected:** 4/29/2021 **Lab ID:** 062107882-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0447 **Collected:** 4/29/2021 **Lab ID:** 062107882-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.4	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0450 **Collected:** 4/29/2021 **Lab ID:** 062107882-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.8	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0451 **Collected:** 4/29/2021 **Lab ID:** 062107882-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0452 **Collected:** 4/29/2021 **Lab ID:** 062107882-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0453 **Collected:** 4/29/2021 **Lab ID:** 062107882-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0453 **Collected:** 4/29/2021 **Lab ID:** 062107882-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.5	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0454 **Collected:** 4/29/2021 **Lab ID:** 062107882-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.4	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0456 **Collected:** 4/29/2021 **Lab ID:** 062107882-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0459 **Collected:** 4/29/2021 **Lab ID:** 062107882-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0460 **Collected:** 4/29/2021 **Lab ID:** 062107882-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.6	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0462 **Collected:** 4/29/2021 **Lab ID:** 062107882-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0463 **Collected:** 4/29/2021 **Lab ID:** 062107882-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0466 **Collected:** 4/29/2021 **Lab ID:** 062107882-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0466 **Collected:** 4/29/2021 **Lab ID:** 062107882-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	41	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0468 **Collected:** 4/29/2021 **Lab ID:** 062107882-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.7	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0469 **Collected:** 4/29/2021 **Lab ID:** 062107882-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0470 **Collected:** 4/29/2021 **Lab ID:** 062107882-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0471 **Collected:** 4/29/2021 **Lab ID:** 062107882-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.1	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0472 **Collected:** 4/29/2021 **Lab ID:** 062107882-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.9	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0475 **Collected:** 4/29/2021 **Lab ID:** 062107882-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0476 **Collected:** 4/29/2021 **Lab ID:** 062107882-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0476 **Collected:** 4/29/2021 **Lab ID:** 062107882-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0477 **Collected:** 4/29/2021 **Lab ID:** 062107882-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0478 **Collected:** 4/29/2021 **Lab ID:** 062107882-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0479 **Collected:** 4/29/2021 **Lab ID:** 062107882-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0482 **Collected:** 4/29/2021 **Lab ID:** 062107882-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0484 **Collected:** 4/29/2021 **Lab ID:** 062107882-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0486 **Collected:** 4/29/2021 **Lab ID:** 062107882-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0487 **Collected:** 4/29/2021 **Lab ID:** 062107882-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0488 **Collected:** 4/29/2021 **Lab ID:** 062107882-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0489 **Collected:** 4/29/2021 **Lab ID:** 062107882-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0490 **Collected:** 4/29/2021 **Lab ID:** 062107882-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0491 **Collected:** 4/29/2021 **Lab ID:** 062107882-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0492 **Collected:** 4/29/2021 **Lab ID:** 062107882-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0494 **Collected:** 4/29/2021 **Lab ID:** 062107882-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0496 **Collected:** 4/29/2021 **Lab ID:** 062107882-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0496	Collected:	4/29/2021	Lab ID:	062107882-0057		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0497	Collected:	4/29/2021	Lab ID:	062107882-0058		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0498	Collected:	4/29/2021	Lab ID:	062107882-0059		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0499	Collected:	4/29/2021	Lab ID:	062107882-0060		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0500	Collected:	4/29/2021	Lab ID:	062107882-0061		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0501	Collected:	4/29/2021	Lab ID:	062107882-0062		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0502	Collected:	4/29/2021	Lab ID:	062107882-0063		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/7/2021	AM	5/10/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0503 **Collected:** 4/29/2021 **Lab ID:** 062107882-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0504 **Collected:** 4/29/2021 **Lab ID:** 062107882-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	59	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0505 **Collected:** 4/29/2021 **Lab ID:** 062107882-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0508 **Collected:** 4/29/2021 **Lab ID:** 062107882-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0509 **Collected:** 4/29/2021 **Lab ID:** 062107882-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0510 **Collected:** 4/29/2021 **Lab ID:** 062107882-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0512 **Collected:** 4/29/2021 **Lab ID:** 062107882-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0514 **Collected:** 4/29/2021 **Lab ID:** 062107882-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0514	Collected:	4/29/2021	Lab ID:	062107882-0071		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0515	Collected:	4/29/2021	Lab ID:	062107882-0072		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0517	Collected:	4/29/2021	Lab ID:	062107882-0073		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0518	Collected:	4/29/2021	Lab ID:	062107882-0074		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		RUFSD-0554	Collected:	4/29/2021	Lab ID:	062107882-0075		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0555	Collected:	4/29/2021	Lab ID:	062107882-0076		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0556	Collected:	4/29/2021	Lab ID:	062107882-0077		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0557	Collected:	4/29/2021	Lab ID:	062107882-0078		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0557		Collected:	4/29/2021	Lab ID:	062107882-0078	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0558		Collected:	4/29/2021	Lab ID:	062107882-0079	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0561		Collected:	4/29/2021	Lab ID:	062107882-0080	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0562		Collected:	4/29/2021	Lab ID:	062107882-0081	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0563		Collected:	4/29/2021	Lab ID:	062107882-0082	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.6	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0565		Collected:	4/29/2021	Lab ID:	062107882-0083	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.7	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0567		Collected:	4/29/2021	Lab ID:	062107882-0084	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0568 **Collected:** 4/29/2021 **Lab ID:** 062107882-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0570 **Collected:** 4/29/2021 **Lab ID:** 062107882-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0571 **Collected:** 4/29/2021 **Lab ID:** 062107882-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0573 **Collected:** 4/29/2021 **Lab ID:** 062107882-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.9	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0575 **Collected:** 4/29/2021 **Lab ID:** 062107882-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0576 **Collected:** 4/29/2021 **Lab ID:** 062107882-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0577 **Collected:** 4/29/2021 **Lab ID:** 062107882-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0580 **Collected:** 4/29/2021 **Lab ID:** 062107882-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0580	Collected:	4/29/2021	Lab ID:	062107882-0092		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0581	Collected:	4/29/2021	Lab ID:	062107882-0093		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0582	Collected:	4/29/2021	Lab ID:	062107882-0094		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0618	Collected:	4/29/2021	Lab ID:	062107882-0095		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0619	Collected:	4/29/2021	Lab ID:	062107882-0096		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0620	Collected:	4/29/2021	Lab ID:	062107882-0097		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0621	Collected:	4/29/2021	Lab ID:	062107882-0098		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0623 **Collected:** 4/29/2021 **Lab ID:** 062107882-0099

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.4	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0630 **Collected:** 4/29/2021 **Lab ID:** 062107882-0100

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0631 **Collected:** 4/29/2021 **Lab ID:** 062107882-0101

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0632 **Collected:** 4/29/2021 **Lab ID:** 062107882-0102

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0634 **Collected:** 4/29/2021 **Lab ID:** 062107882-0103

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0635 **Collected:** 4/29/2021 **Lab ID:** 062107882-0104

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0636 **Collected:** 4/29/2021 **Lab ID:** 062107882-0105

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0640 **Collected:** 4/29/2021 **Lab ID:** 062107882-0106

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0640 **Collected:** 4/29/2021 **Lab ID:** 062107882-0106

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0641 **Collected:** 4/29/2021 **Lab ID:** 062107882-0107

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.9	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0642 **Collected:** 4/29/2021 **Lab ID:** 062107882-0108

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0643 **Collected:** 4/29/2021 **Lab ID:** 062107882-0109

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0644 **Collected:** 4/29/2021 **Lab ID:** 062107882-0110

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0647 **Collected:** 4/29/2021 **Lab ID:** 062107882-0111

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description RUFSD-0648 **Collected:** 4/29/2021 **Lab ID:** 062107882-0112

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107882

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/29/2021 03:25 PM
 Collected: 4/29/2021

Project: 19-45373, Roosevelt Middle School, Roosevelt Union Free School District, 335 E. Clinton Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0649	Collected:	4/29/2021	Lab ID:	062107882-0113		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0650	Collected:	4/29/2021	Lab ID:	062107882-0114		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0651	Collected:	4/29/2021	Lab ID:	062107882-0115		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0	µg/L	5/7/2021	AM	5/10/2021	AL
Client Sample Description		RUFSD-0998	Collected:	4/29/2021	Lab ID:	062107882-0116		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0	µg/L	5/7/2021	AM	5/10/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Ulysses Byas Elementary School

UBES

062107554

Page 1 of 4

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0148	KI	N/A	Kitchen	IM	4/27/2021	5:22:00 AM
RUFSD-0149	KI	N/A	Kitchen	KC	4/27/2021	5:26:00 AM
RUFSD-0150	KI	N/A	Kitchen	KC	4/27/2021	5:26:00 AM
RUFSD-0151	KI	N/A	Kitchen	KC	4/27/2021	5:28:00 AM
RUFSD-0152	KI	N/A	Kitchen	SN	4/27/2021	5:28:00 AM
RUFSD-0153	KI	N/A	Kitchen	HW	4/27/2021	5:29:00 AM
RUFSD-0154	KI	N/A	Kitchen	PK	4/27/2021	5:29:00 AM
RUFSD-0155	KI	N/A	Kitchen	KC	4/27/2021	5:25:00 AM
RUFSD-0156	KI	N/A	Kitchen	KC	4/27/2021	5:24:00 AM
RUFSD-0157	KI	N/A	Kitchen	SN	4/27/2021	5:25:00 AM
RUFSD-0158	KI	N/A	Kitchen Serving Area	KC	4/27/2021	5:30:00 AM
RUFSD-0159	KI	N/A	Kitchen Serving Area	HW	4/27/2021	5:30:00 AM
RUFSD-0161	FL	N/A	1st Floor Faculty Lounge 1008	KC	4/27/2021	5:31:00 AM
RUFSD-0162	ST	N/A	Pantry Storage 1005A (Across From Boy's Locker Room)	KN	4/27/2021	5:33:00 AM
RUFSD-0172	BR	N/A	Main Office Bathroom 1	BF	4/27/2021	5:36:00 AM
RUFSD-0174	BR	N/A	Main Office Bathroom 2	BF	4/27/2021	5:35:00 AM
RUFSD-0176	OF	N/A	Main Office Mail/Copy Room 1039	KC	4/27/2021	5:34:00 AM
RUFSD-0177	NO	N/A	Nurse's Office Exam Room 1066	NS	4/27/2021	5:40:00 AM

Building Address

60 Underhill Avenue

Roosevelt, NY 11575

Pb 200.5-

Alfonso 05/03/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Alexandria Orlassino

A Orlassino

Tara Ricker

OrderID: 062107554



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Ulysses Byas Elementary School

UBES

062107554

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 2 of 4

Order ID: 062107554

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0178	NO	N/A	Nurse's Office Exam Room 1066	IM	4/27/2021	5:42:00 AM
RUFSD-0181	CR	N/A	Room 1046	CF	4/27/2021	5:44:00 AM
RUFSD-0182	CR	N/A	Room 1046	DW	4/27/2021	5:43:00 AM
RUFSD-0185	CR	N/A	Room 1062	CF	4/27/2021	5:46:00 AM
RUFSD-0186	CR	N/A	Room 1062	DW	4/27/2021	5:46:00 AM
RUFSD-0189	CR	N/A	Room 1060	CF	4/27/2021	5:48:00 AM
RUFSD-0191	CR	N/A	Room 1048	CF	4/27/2021	5:47:00 AM
RUFSD-0192	CR	N/A	Room 1048	DW	4/27/2021	5:47:00 AM
RUFSD-0195	CR	N/A	Room 1050	CF	4/27/2021	5:51:00 AM
RUFSD-0196	CR	N/A	Room 1050	DW	4/27/2021	5:51:00 AM
RUFSD-0197	CR	N/A	Room 1059	CF	4/27/2021	5:52:00 AM
RUFSD-0198	CR	N/A	Room 1059	DW	4/27/2021	5:52:00 AM
RUFSD-0201	CR	N/A	Room 1057	CF	4/27/2021	5:54:00 AM
RUFSD-0202	CR	N/A	Room 1057	DW	4/27/2021	5:54:00 AM
RUFSD-0203	CR	N/A	Room 1051	CF	4/27/2021	5:55:00 AM
RUFSD-0204	CR	N/A	Room 1051	DW	4/27/2021	5:55:00 AM
RUFSD-0207	CR	N/A	Room 1053	CF	4/27/2021	5:57:00 AM
RUFSD-0208	CR	N/A	Room 1053	DW	4/27/2021	5:57:00 AM

RECEIVED
ENGLAND ANALYTICAL, INC.
LABORATORY
APR 28 2021
PE 5:16

Building Address

60 Underhill Avenue

Roosevelt, NY 11575

P200.5 -

Alvin Perry 05/03/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Alexandria Orlassino

Orlassino

Tara Ricker



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Ulysses Byas Elementary School

UBES

062107554

Page 3 of 4

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal ~~Expedite~~ Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0209	CR	N/A	Room 1055	CF	4/27/2021	5:58:00 AM
RUFSD-0210	CR	N/A	Room 1055	DW	4/27/2021	5:58:00 AM
RUFSD-0213	CR	N/A	Room 2027	CF	4/27/2021	6:24:00 AM
RUFSD-0214	CR	N/A	Room 2027	DW	4/27/2021	6:24:00 AM
RUFSD-0226	FL	N/A	2nd Floor Faculty Lounge	KC	4/27/2021	6:22:00 AM
RUFSD-0227	OF	N/A	2nd Floor Principal's Office 2042	KC	4/27/2021	6:19:00 AM
RUFSD-0234	OF	N/A	Library Office	KC	4/27/2021	6:18:00 AM
RUFSD-0235	CR	N/A	Room 2008	CF	4/27/2021	6:13:00 AM
RUFSD-0236	CR	N/A	Room 2008	DW	4/27/2021	6:13:00 AM
RUFSD-0239	CR	N/A	Room 2017	CF	4/27/2021	6:11:00 AM
RUFSD-0240	CR	N/A	Room 2017	DW	4/27/2021	6:11:00 AM
RUFSD-0243	CR	N/A	Room 2015	CF	4/27/2021	6:09:00 AM
RUFSD-0244	CR	N/A	Room 2015	DW	4/27/2021	6:09:00 AM
RUFSD-0245	CR	N/A	Room 2009	CF	4/27/2021	6:08:00 AM
RUFSD-0246	CR	N/A	Room 2009	DW	4/27/2021	6:08:00 AM
RUFSD-0249	CR	N/A	Room 2011	CF	4/27/2021	6:06:00 AM
RUFSD-0250	CR	N/A	Room 2011	DW	4/27/2021	6:06:00 AM
RUFSD-0251	SC	N/A	Science Room 2012	SF	4/27/2021	6:04:00 AM

Building Address

60 Underhill Avenue

Roosevelt, NY 11575

Pb 200.5 -

Alyssa 05/03/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassing

Samplers Signature: A. Orlassing

JCB Project Manager: Tara Ricker

RECEIVED
EHS - ANALYTICAL INC.
CARL PLACENTIA, NJ
21 APR 27 PM 5:15

OrderID: 062107554



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Ulysses Byas Elementary School

UBES

062107554

Page 4 of 4

Client:

Roosevelt Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0252	SC	N/A	Science Room 2012	SF	4/27/2021	6:04:00 AM
RUFSD-0257	CR	N/A	Room 3003	CF	4/27/2021	6:40:00 AM
RUFSD-0261	CR	N/A	Room 3038	CF	4/27/2021	6:30:00 AM
RUFSD-0262	CR	N/A	Room 3038	DW	4/27/2021	6:31:00 AM
RUFSD-0263	CR	N/A	Room 3038	CF	4/27/2021	6:31:00 AM
RUFSD-0272	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/27/2021	6:33:00 AM

Samples Submitted 60

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
21 APR 27 PM 5:16

Building Address

60 Underhill Avenue

Roosevelt, NY 11575

06200.5-

Alex J. J. 05/03/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Sampler's Name: Alexandria Orlassino

Sampler's Signature: *Alex Orlassino*

JCB Project Manager: Tara Ricker



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/12/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 4/27/2021. The results are tabulated on the attached data pages for the following client designated project:

19-45373, Ulysses Byas Elementary School, Roosevelt Union
Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

The reference number for these samples is EMSL Order #062107554. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107554

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/27/2021 05:16 PM
 Collected: 4/27/2021

Project: 19-45373, Ulysses Byas Elementary School, Roosevelt Union Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0148 **Collected:** 4/27/2021 **Lab ID:** 062107554-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0149 **Collected:** 4/27/2021 **Lab ID:** 062107554-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0150 **Collected:** 4/27/2021 **Lab ID:** 062107554-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0151 **Collected:** 4/27/2021 **Lab ID:** 062107554-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0152 **Collected:** 4/27/2021 **Lab ID:** 062107554-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0153 **Collected:** 4/27/2021 **Lab ID:** 062107554-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0154 **Collected:** 4/27/2021 **Lab ID:** 062107554-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107554

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/27/2021 05:16 PM
 Collected: 4/27/2021

Project: 19-45373, Ulysses Byas Elementary School, Roosevelt Union Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0155 **Collected:** 4/27/2021 **Lab ID:** 062107554-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.5	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0156 **Collected:** 4/27/2021 **Lab ID:** 062107554-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0157 **Collected:** 4/27/2021 **Lab ID:** 062107554-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0158 **Collected:** 4/27/2021 **Lab ID:** 062107554-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0159 **Collected:** 4/27/2021 **Lab ID:** 062107554-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0161 **Collected:** 4/27/2021 **Lab ID:** 062107554-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0162 **Collected:** 4/27/2021 **Lab ID:** 062107554-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.6	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107554

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/27/2021 05:16 PM
 Collected: 4/27/2021

Project: 19-45373, Ulysses Byas Elementary School, Roosevelt Union Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0172		Collected:	4/27/2021	Lab ID:	062107554-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0174		Collected:	4/27/2021	Lab ID:	062107554-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0176		Collected:	4/27/2021	Lab ID:	062107554-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0177		Collected:	4/27/2021	Lab ID:	062107554-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0178		Collected:	4/27/2021	Lab ID:	062107554-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0181		Collected:	4/27/2021	Lab ID:	062107554-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0182		Collected:	4/27/2021	Lab ID:	062107554-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.5	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0185		Collected:	4/27/2021	Lab ID:	062107554-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107554

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/27/2021 05:16 PM
 Collected: 4/27/2021

Project: 19-45373, Ulysses Byas Elementary School, Roosevelt Union Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0185 **Collected:** 4/27/2021 **Lab ID:** 062107554-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0186 **Collected:** 4/27/2021 **Lab ID:** 062107554-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0189 **Collected:** 4/27/2021 **Lab ID:** 062107554-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0191 **Collected:** 4/27/2021 **Lab ID:** 062107554-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0192 **Collected:** 4/27/2021 **Lab ID:** 062107554-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0195 **Collected:** 4/27/2021 **Lab ID:** 062107554-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.1	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0196 **Collected:** 4/27/2021 **Lab ID:** 062107554-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.4	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0197 **Collected:** 4/27/2021 **Lab ID:** 062107554-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107554

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/27/2021 05:16 PM
 Collected: 4/27/2021

Project: 19-45373, Ulysses Byas Elementary School, Roosevelt Union Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0197 **Collected:** 4/27/2021 **Lab ID:** 062107554-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0198 **Collected:** 4/27/2021 **Lab ID:** 062107554-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0201 **Collected:** 4/27/2021 **Lab ID:** 062107554-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0202 **Collected:** 4/27/2021 **Lab ID:** 062107554-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0203 **Collected:** 4/27/2021 **Lab ID:** 062107554-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0204 **Collected:** 4/27/2021 **Lab ID:** 062107554-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0207 **Collected:** 4/27/2021 **Lab ID:** 062107554-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0208 **Collected:** 4/27/2021 **Lab ID:** 062107554-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107554

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/27/2021 05:16 PM
 Collected: 4/27/2021

Project: 19-45373, Ulysses Byas Elementary School, Roosevelt Union Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0208 **Collected:** 4/27/2021 **Lab ID:** 062107554-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0209 **Collected:** 4/27/2021 **Lab ID:** 062107554-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0210 **Collected:** 4/27/2021 **Lab ID:** 062107554-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0213 **Collected:** 4/27/2021 **Lab ID:** 062107554-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0214 **Collected:** 4/27/2021 **Lab ID:** 062107554-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0226 **Collected:** 4/27/2021 **Lab ID:** 062107554-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0227 **Collected:** 4/27/2021 **Lab ID:** 062107554-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0234 **Collected:** 4/27/2021 **Lab ID:** 062107554-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107554

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/27/2021 05:16 PM
 Collected: 4/27/2021

Project: 19-45373, Ulysses Byas Elementary School, Roosevelt Union Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0234 **Collected:** 4/27/2021 **Lab ID:** 062107554-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.3	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0235 **Collected:** 4/27/2021 **Lab ID:** 062107554-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.4	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0236 **Collected:** 4/27/2021 **Lab ID:** 062107554-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0239 **Collected:** 4/27/2021 **Lab ID:** 062107554-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0240 **Collected:** 4/27/2021 **Lab ID:** 062107554-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0243 **Collected:** 4/27/2021 **Lab ID:** 062107554-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0244 **Collected:** 4/27/2021 **Lab ID:** 062107554-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0245 **Collected:** 4/27/2021 **Lab ID:** 062107554-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107554

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/27/2021 05:16 PM
 Collected: 4/27/2021

Project: 19-45373, Ulysses Byas Elementary School, Roosevelt Union Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0245	Collected:	4/27/2021	Lab ID:	062107554-0050		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.7	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0246	Collected:	4/27/2021	Lab ID:	062107554-0051		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0249	Collected:	4/27/2021	Lab ID:	062107554-0052		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0250	Collected:	4/27/2021	Lab ID:	062107554-0053		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0251	Collected:	4/27/2021	Lab ID:	062107554-0054		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	39	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0252	Collected:	4/27/2021	Lab ID:	062107554-0055		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0257	Collected:	4/27/2021	Lab ID:	062107554-0056		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0	µg/L	4/30/2021	AM	5/3/2021	AL
Client Sample Description		RUFSD-0261	Collected:	4/27/2021	Lab ID:	062107554-0057		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107554

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 4/27/2021 05:16 PM
Collected: 4/27/2021

Project: 19-45373, Ulysses Byas Elementary School, Roosevelt Union Free School District, 60 Underhill Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0261 **Collected:** 4/27/2021 **Lab ID:** 062107554-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	650 D	60 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0262 **Collected:** 4/27/2021 **Lab ID:** 062107554-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0263 **Collected:** 4/27/2021 **Lab ID:** 062107554-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Client Sample Description RUFSD-0272 **Collected:** 4/27/2021 **Lab ID:** 062107554-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	4/30/2021	AM	5/3/2021	AL

Lead MDL: 1.0µg/L

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Washington-Rose Elementary School

WES

062107347

Client:

Roosevelt Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 6

OrderID: 062107347

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0001	CR	N/A	Room 1026	CF	4/23/2021	5:37:00 AM
RUFSD-0002	CR	N/A	Room 1026	DW	4/23/2021	5:37:00 AM
RUFSD-0003	BR	N/A	Room 1026 Bathroom	BF	4/23/2021	5:38:00 AM
RUFSD-0005	CR	N/A	Room 1028	CF	4/23/2021	5:39:00 AM
RUFSD-0006	CR	N/A	Room 1028	DW	4/23/2021	5:39:00 AM
RUFSD-0007	BR	N/A	1st Floor Staff Bathroom (Adjacent to Room 1028)	BF	4/23/2021	5:40:00 AM
RUFSD-0009	CR	N/A	Room 1025	CF	4/23/2021	5:41:00 AM
RUFSD-0010	CR	N/A	Room 1025	DW	4/23/2021	5:41:00 AM
RUFSD-0011	BR	N/A	Shared Bathroom in Room 1025 & Room 1023	BF	4/23/2021	5:42:00 AM
RUFSD-0013	CR	N/A	Room 1023	CF	4/23/2021	5:43:00 AM
RUFSD-0014	CR	N/A	Room 1023	DW	4/23/2021	5:43:00 AM
RUFSD-0015	NO	N/A	Nurse's Suite (1034) Exam Room 1031	NS	4/23/2021	5:49:00 AM
RUFSD-0016	BR	N/A	Nurse's Suite 1034 Bathroom	BF	4/23/2021	5:49:00 AM
RUFSD-0018	BR	N/A	1st Floor Isolation Bathroom (Adjacent to Nurse's Suite 1034)	BF	4/23/2021	5:48:00 AM
RUFSD-0020	HA	N/A	1st Floor Corridor Main Lobby to Stairs C (Across Room 1023)	DW	4/23/2021	5:47:00 AM
RUFSD-0021	HA	N/A	1st Floor Corridor Main Lobby to Stairs C (Across Room 1023)	DW	4/23/2021	5:47:00 AM
RUFSD-0022	BR	N/A	Principal's Bathroom (Across From I.S.S Room 1043)	BF	4/23/2021	5:51:00 AM
RUFSD-0024	OF	N/A	Admin Suite (1044) Mail/Copy Room 1046	KC	4/23/2021	5:51:00 AM

Building Address

2 Rose Avenue

Roosevelt, NY 11575

200.5

A. Lundy 04/30/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: AOrlassino

JCB Project Manager: Tara Ricker



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Washington-Rose Elementary School

WES

062107347

Page 2 of 6

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0025	BR	N/A	1st Floor Staff Bathroom (Adjacent to Admin Suite 1044)	BF	4/23/2021	5:46:00 AM
RUFSD-0027	CR	N/A	Room 1022	CF	4/23/2021	5:45:00 AM
RUFSD-0028	CR	N/A	Room 1022	HB	4/23/2021	5:45:00 AM
RUFSD-0029	BR	N/A	Room 1022 Bathroom	BF	4/23/2021	5:46:00 AM
RUFSD-0031	CR	N/A	Room 1004	CF	4/23/2021	6:09:00 AM
RUFSD-0032	CR	N/A	Room 1004	DW	4/23/2021	6:09:00 AM
RUFSD-0033	BR	N/A	Room 1004 Bathroom	BF	4/23/2021	6:10:00 AM
RUFSD-0035	CR	N/A	Room 1018	CF	4/23/2021	5:54:00 AM
RUFSD-0036	CR	N/A	Room 1018	DW	4/23/2021	5:53:00 AM
RUFSD-0037	BR	N/A	Shared Bathroom in Room 1018 & Room 1016	BF	4/23/2021	5:55:00 AM
RUFSD-0039	CR	N/A	Room 1016	CF	4/23/2021	5:55:00 AM
RUFSD-0040	CR	N/A	Room 1016	DW	4/23/2021	5:56:00 AM
RUFSD-0041	CR	N/A	Room 1005	CF	4/23/2021	6:08:00 AM
RUFSD-0042	CR	N/A	Room 1005	DW	4/23/2021	6:08:00 AM
RUFSD-0043	BR	N/A	Shared Bathroom in Room 1005 & Room 1007	BF	4/23/2021	6:06:00 AM
RUFSD-0045	CR	N/A	Room 1007	CF	4/23/2021	6:06:00 AM
RUFSD-0046	CR	N/A	Room 1007	DW	4/23/2021	6:05:00 AM
RUFSD-0047	CR	N/A	Room 1015	CF	4/23/2021	5:58:00 AM

Building Address

2 Rose Avenue

Roosevelt, NY 11575

Pb 200.5

[Signature] 04/30/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

[Signature]

Sampler's Name: Alexandria Orlassino

Sampler's Signature: A Orlassino

JCB Project Manager: Tara Ricker

RECEIVED
ENVIRONMENTAL, INC.
CARLE PLACE, NY
APR 23 2021 4:06 PM

OrderID: 062107347



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373
Building: Washington-Rose Elementary School
WES

0621 07347

Client:
Roosevelt Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0048	CR	N/A	Room 1015	DW	4/23/2021	5:57:00 AM
RUFSD-0049	BR	N/A	Shared Bathroom in Room 1015 & Room 1013	BF	4/23/2021	5:59:00 AM
RUFSD-0051	CR	N/A	Room 1013	CF	4/23/2021	5:59:00 AM
RUFSD-0052	CR	N/A	Room 1013	DW	4/23/2021	5:59:00 AM
RUFSD-0053	CR	N/A	Room 1008	CF	4/23/2021	6:04:00 AM
RUFSD-0054	CR	N/A	Room 1008	DW	4/23/2021	6:04:00 AM
RUFSD-0055	BR	N/A	Shared Bathroom in Room 1008 & Room 1010	BF	4/23/2021	6:03:00 AM
RUFSD-0057	CR	N/A	Room 1010	CF	4/23/2021	6:02:00 AM
RUFSD-0058	CR	N/A	Room 1010	DW	4/23/2021	6:02:00 AM
RUFSD-0059	CR	N/A	Room 1012	CF	4/23/2021	6:00:00 AM
RUFSD-0060	CR	N/A	Room 1012	DW	4/23/2021	6:00:00 AM
RUFSD-0061	BR	N/A	Room 1012 Bathroom	BF	4/23/2021	6:01:00 AM
RUFSD-0066	GY	N/A	Gym Entrance Vestibule	DW	4/23/2021	5:32:00 AM
RUFSD-0067	GY	N/A	Gym Entrance Vestibule	DW	4/23/2021	5:32:00 AM
RUFSD-0068	BR	N/A	1st Floor Girls Gang Bathroom	BF	4/23/2021	5:30:00 AM
RUFSD-0071	HA	N/A	1st Floor Corridor Storage 1073 to Staff Locker 1066A (Adjacent to Girl's Gang Bathroom)	DW	4/23/2021	5:28:00 AM
RUFSD-0072	HA	N/A	1st Floor Corridor Storage 1073 to Staff Locker 1066A (Adjacent to Girl's Gang Bathroom)	DW	4/23/2021	5:28:00 AM
RUFSD-0073	KI	N/A	Kitchen Serving Area	HW	4/23/2021	5:23:00 AM

RECEIVED
EPI-ANALYTICAL, INC.
LABORATORY
APR 23 2021
11:00 AM

Building Address
2 Rose Avenue
Roosevelt, NY 11575

Pb200.5 -
J. Perry 04/30/21

Analysis Type: ELAP 200.5

Lab Recieved:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Tara Ricker



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Washington-Rose Elementary School

WES

062107347

Client:

Roosevelt Union Free School District

Retest/New Install: 1

Turn Around: Normal 1 wk Rush _____

Page 4 of 6

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0074	KI	N/A	Kitchen Serving Area	KC	4/23/2021	5:23:00 AM
RUFSD-0075	KI	N/A	Kitchen	IM	4/23/2021	5:16:00 AM
RUFSD-0076	KI	N/A	Kitchen	KC	4/23/2021	5:20:00 AM
RUFSD-0077	KI	N/A	Kitchen	SN	4/23/2021	5:20:00 AM
RUFSD-0078	KI	N/A	Kitchen	KC	4/23/2021	5:21:00 AM
RUFSD-0079	KI	N/A	Kitchen	KC	4/23/2021	5:19:00 AM
RUFSD-0080	KI	N/A	Kitchen	PK	4/23/2021	5:19:00 AM
RUFSD-0081	KI	N/A	Kitchen	HW	4/23/2021	5:19:00 AM
RUFSD-0082	KI	N/A	Kitchen	KC	4/23/2021	5:18:00 AM
RUFSD-0084	FL	N/A	Faculty Dining 1058	KC	4/23/2021	5:24:00 AM
RUFSD-0085	ST	N/A	Storage Closet in Faculty Dining 1058	KN	4/23/2021	5:25:00 AM
RUFSD-0086	BR	N/A	Womens Staff Locker Room 1067A	BF	4/23/2021	5:26:00 AM
RUFSD-0088	BR	N/A	Mens Staff Locker Room 1066A	BF	4/23/2021	5:26:00 AM
RUFSD-0090	OF	N/A	Library Office (2nd Floor)	HW	4/23/2021	6:15:00 AM
RUFSD-0091	BR	N/A	Library Bathroom (2nd Floor)	BF	4/23/2021	6:15:00 AM
RUFSD-0093	CR	N/A	Music Room 2032	CF	4/23/2021	6:12:00 AM
RUFSD-0094	CR	N/A	Music Room 2032	DW	4/23/2021	6:12:00 AM
RUFSD-0095	CR	N/A	Room 2016	CF	4/23/2021	6:17:00 AM

Building Address

2 Rose Avenue
Roosevelt, NY 11575

Pb 200.5 -

A. Perry 04/30/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Tara Ricker

RECEIVED
EPA ANALYTICAL, INC.
LABORATORY
2 APR 23 PM 4:06
CARLE PLACE, NY

OrderID: 062107347



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Washington-Rose Elementary School

WES

062107347

Client:

Roosevelt Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 5 of 6

Order ID: 062107347

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0096	CR	N/A	Room 2016	DW	4/23/2021	6:17:00 AM
RUFSD-0097	BR	N/A	Room 2016 Bathroom	BF	4/23/2021	6:18:00 AM
RUFSD-0099	BR	N/A	2nd Floor Girls Gang Bathroom	BF	4/23/2021	6:19:00 AM
RUFSD-0100	BR	N/A	2nd Floor Girls Gang Bathroom	BF	4/23/2021	6:19:00 AM
RUFSD-0101	BR	N/A	2nd Floor Girls Gang Bathroom	BF	4/23/2021	6:20:00 AM
RUFSD-0104	HA	N/A	2nd Floor Corridor Room 2007 to Library (Adjacent to Science Room 2011)	DW	4/23/2021	6:21:00 AM
RUFSD-0105	HA	N/A	2nd Floor Corridor Room 2007 to Library (Adjacent to Science Room 2011)	DW	4/23/2021	6:21:00 AM
RUFSD-0107	BR	N/A	2nd Floor Boys Gang Bathroom	BF	4/23/2021	6:22:00 AM
RUFSD-0111	CR	N/A	Room 2007	CF	4/23/2021	6:26:00 AM
RUFSD-0112	CR	N/A	Room 2007	DW	4/23/2021	6:26:00 AM
RUFSD-0113	BR	N/A	Room 2007 Bathroom	BF	4/23/2021	6:27:00 AM
RUFSD-0115	CR	N/A	Room 3007	CF	4/23/2021	6:38:00 AM
RUFSD-0116	CR	N/A	Room 3007	DW	4/23/2021	6:38:00 AM
RUFSD-0117	BR	N/A	Room 3007 Bathroom	BF	4/23/2021	6:39:00 AM
RUFSD-0119	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/23/2021	6:36:00 AM
RUFSD-0120	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/23/2021	6:37:00 AM
RUFSD-0121	BR	N/A	3rd Floor Boys Gang Bathroom	BF	4/23/2021	6:37:00 AM
RUFSD-0123	HA	N/A	3rd Floor Corridor Room 3007 to Stairs C (Adjacent to Faculty Lounge)	DW	4/23/2021	6:35:00 AM

Building Address

2 Rose Avenue
Roosevelt, NY 11575

Pb 200.5 -

A. Long 04/30/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Alexandria Orlassino

A. Orlassino

Tara Ricker

RECEIVED
INST. ANALYTICAL, INC.
CARLE PLACE, N.Y.
21 APR 23 PM 4:35



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45373

Building: Washington-Rose Elementary School

WES

062107347

Client:

Roosevelt Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Page 6 of 6

Order ID: 062107347

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
RUFSD-0124	HA	N/A	3rd Floor Corridor Room 3007 to Stairs C (Adjacent to Faculty Lounge)	DW	4/23/2021	6:35:00 AM
RUFSD-0126	BR	N/A	3rd Floor Girls Gang Bathroom	BF	4/23/2021	6:32:00 AM
RUFSD-0127	BR	N/A	3rd Floor Girls Gang Bathroom	BF	4/23/2021	6:33:00 AM
RUFSD-0128	BR	N/A	3rd Floor Girls Gang Bathroom	BF	4/23/2021	6:33:00 AM
RUFSD-0130	FL	N/A	3rd Floor Faculty Lounge	KC	4/23/2021	6:31:00 AM
RUFSD-0131	BR	N/A	3rd Floor Faculty Lounge Bathroom	BF	4/23/2021	6:31:00 AM
RUFSD-0992	BR	N/A	1st Floor Girls Gang Bathroom	BF	4/23/2021	5:30:00 AM
RUFSD-0993	BR	N/A	1st Floor Boys Gang Bathroom	BF	4/23/2021	5:34:00 AM
RUFSD-0994	BR	N/A	1st Floor Boys Gang Bathroom	BF	4/23/2021	5:34:00 AM
RUFSD-0995	BR	N/A	2nd Floor Boys Gang Bathroom	BF	4/23/2021	6:23:00 AM
RUFSD-0996	BR	N/A	2nd Floor Boys Gang Bathroom	BF	4/23/2021	6:23:00 AM

Samples Submitted 101

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
1 APR 23 PM 4:06

Building Address

2 Rose Avenue

Roosevelt, NY 11575

Pb 200.5 -

[Signature] 04/30/21

Analysis Type: ELAP 200.5

Lab Received: *[Signature]*

Signature: *[Signature]*

Sampler's Name: Alexandria Orlassino

Sampler's Signature: *[Signature]*

JCB Project Manager: Tara Ricker



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/12/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 4/23/2021. The results are tabulated on the attached data pages for the following client designated project:

#19-45373, Washington-Rose Elementary School, Roosevelt
Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

The reference number for these samples is EMSL Order #062107347. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0001		Collected:	4/23/2021	Lab ID:	062107347-0001	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0002		Collected:	4/23/2021	Lab ID:	062107347-0002	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0003		Collected:	4/23/2021	Lab ID:	062107347-0003	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0005		Collected:	4/23/2021	Lab ID:	062107347-0004	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0006		Collected:	4/23/2021	Lab ID:	062107347-0005	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0007		Collected:	4/23/2021	Lab ID:	062107347-0006	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.4	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0009		Collected:	4/23/2021	Lab ID:	062107347-0007	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0010		Collected:	4/23/2021	Lab ID:	062107347-0008	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0010		Collected:	4/23/2021	Lab ID:	062107347-0008	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0011		Collected:	4/23/2021	Lab ID:	062107347-0009	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.1	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0013		Collected:	4/23/2021	Lab ID:	062107347-0010	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0014		Collected:	4/23/2021	Lab ID:	062107347-0011	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0015		Collected:	4/23/2021	Lab ID:	062107347-0012	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0016		Collected:	4/23/2021	Lab ID:	062107347-0013	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	25	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0018		Collected:	4/23/2021	Lab ID:	062107347-0014	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0020		Collected:	4/23/2021	Lab ID:	062107347-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0020 **Collected:** 4/23/2021 **Lab ID:** 062107347-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0021 **Collected:** 4/23/2021 **Lab ID:** 062107347-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0022 **Collected:** 4/23/2021 **Lab ID:** 062107347-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	4/29/2021	AM	4/30/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0024 **Collected:** 4/23/2021 **Lab ID:** 062107347-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	4/29/2021	AM	4/30/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0025 **Collected:** 4/23/2021 **Lab ID:** 062107347-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0027 **Collected:** 4/23/2021 **Lab ID:** 062107347-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0028 **Collected:** 4/23/2021 **Lab ID:** 062107347-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0029 **Collected:** 4/23/2021 **Lab ID:** 062107347-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	4/29/2021	AM	4/30/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0031 **Collected:** 4/23/2021 **Lab ID:** 062107347-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	4/29/2021	AM	4/30/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0032 **Collected:** 4/23/2021 **Lab ID:** 062107347-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0033 **Collected:** 4/23/2021 **Lab ID:** 062107347-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0035 **Collected:** 4/23/2021 **Lab ID:** 062107347-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0036 **Collected:** 4/23/2021 **Lab ID:** 062107347-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0037 **Collected:** 4/23/2021 **Lab ID:** 062107347-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.7	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0039 **Collected:** 4/23/2021 **Lab ID:** 062107347-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0040 **Collected:** 4/23/2021 **Lab ID:** 062107347-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0041 **Collected:** 4/23/2021 **Lab ID:** 062107347-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0042 **Collected:** 4/23/2021 **Lab ID:** 062107347-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0043 **Collected:** 4/23/2021 **Lab ID:** 062107347-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0045 **Collected:** 4/23/2021 **Lab ID:** 062107347-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Client Sample Description RUFSD-0046 **Collected:** 4/23/2021 **Lab ID:** 062107347-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0047		Collected:	4/23/2021	Lab ID:	062107347-0036	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0048		Collected:	4/23/2021	Lab ID:	062107347-0037	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0049		Collected:	4/23/2021	Lab ID:	062107347-0038	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0051		Collected:	4/23/2021	Lab ID:	062107347-0039	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0052		Collected:	4/23/2021	Lab ID:	062107347-0040	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/29/2021	AM	4/30/2021	AL
Client Sample Description		RUFSD-0053		Collected:	4/23/2021	Lab ID:	062107347-0041	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0054		Collected:	4/23/2021	Lab ID:	062107347-0042	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0055		Collected:	4/23/2021	Lab ID:	062107347-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0055 **Collected:** 4/23/2021 **Lab ID:** 062107347-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0057 **Collected:** 4/23/2021 **Lab ID:** 062107347-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	4/28/2021	DI	4/29/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0058 **Collected:** 4/23/2021 **Lab ID:** 062107347-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0059 **Collected:** 4/23/2021 **Lab ID:** 062107347-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	4/28/2021	DI	4/29/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0060 **Collected:** 4/23/2021 **Lab ID:** 062107347-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	4/28/2021	DI	4/29/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0061 **Collected:** 4/23/2021 **Lab ID:** 062107347-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0066 **Collected:** 4/23/2021 **Lab ID:** 062107347-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	4/28/2021	DI	4/29/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0067 **Collected:** 4/23/2021 **Lab ID:** 062107347-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0068 **Collected:** 4/23/2021 **Lab ID:** 062107347-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0071 **Collected:** 4/23/2021 **Lab ID:** 062107347-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0072 **Collected:** 4/23/2021 **Lab ID:** 062107347-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0073 **Collected:** 4/23/2021 **Lab ID:** 062107347-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0074 **Collected:** 4/23/2021 **Lab ID:** 062107347-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0075 **Collected:** 4/23/2021 **Lab ID:** 062107347-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0076 **Collected:** 4/23/2021 **Lab ID:** 062107347-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0076	Collected:	4/23/2021	Lab ID:	062107347-0057		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0077	Collected:	4/23/2021	Lab ID:	062107347-0058		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.9	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0078	Collected:	4/23/2021	Lab ID:	062107347-0059		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.8	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0079	Collected:	4/23/2021	Lab ID:	062107347-0060		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0080	Collected:	4/23/2021	Lab ID:	062107347-0061		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0081	Collected:	4/23/2021	Lab ID:	062107347-0062		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0082	Collected:	4/23/2021	Lab ID:	062107347-0063		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0084	Collected:	4/23/2021	Lab ID:	062107347-0064		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0084 **Collected:** 4/23/2021 **Lab ID:** 062107347-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0085 **Collected:** 4/23/2021 **Lab ID:** 062107347-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.6	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0086 **Collected:** 4/23/2021 **Lab ID:** 062107347-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0088 **Collected:** 4/23/2021 **Lab ID:** 062107347-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description RUFSD-0090 **Collected:** 4/23/2021 **Lab ID:** 062107347-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	95	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0091 **Collected:** 4/23/2021 **Lab ID:** 062107347-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0093 **Collected:** 4/23/2021 **Lab ID:** 062107347-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0094 **Collected:** 4/23/2021 **Lab ID:** 062107347-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0094 **Collected:** 4/23/2021 **Lab ID:** 062107347-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	4/28/2021	DI	4/29/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description RUFSD-0095 **Collected:** 4/23/2021 **Lab ID:** 062107347-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0096 **Collected:** 4/23/2021 **Lab ID:** 062107347-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0097 **Collected:** 4/23/2021 **Lab ID:** 062107347-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.6	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0099 **Collected:** 4/23/2021 **Lab ID:** 062107347-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	18	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0100 **Collected:** 4/23/2021 **Lab ID:** 062107347-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0101 **Collected:** 4/23/2021 **Lab ID:** 062107347-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0104 **Collected:** 4/23/2021 **Lab ID:** 062107347-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0104		Collected:	4/23/2021	Lab ID:	062107347-0078	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0105		Collected:	4/23/2021	Lab ID:	062107347-0079	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0107		Collected:	4/23/2021	Lab ID:	062107347-0080	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.0	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0111		Collected:	4/23/2021	Lab ID:	062107347-0081	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0112		Collected:	4/23/2021	Lab ID:	062107347-0082	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0113		Collected:	4/23/2021	Lab ID:	062107347-0083	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0115		Collected:	4/23/2021	Lab ID:	062107347-0084	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0116		Collected:	4/23/2021	Lab ID:	062107347-0085	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0116		Collected:	4/23/2021	Lab ID:	062107347-0085	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RUFSD-0117		Collected:	4/23/2021	Lab ID:	062107347-0086	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0119		Collected:	4/23/2021	Lab ID:	062107347-0087	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0120		Collected:	4/23/2021	Lab ID:	062107347-0088	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0121		Collected:	4/23/2021	Lab ID:	062107347-0089	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0123		Collected:	4/23/2021	Lab ID:	062107347-0090	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0124		Collected:	4/23/2021	Lab ID:	062107347-0091	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0126		Collected:	4/23/2021	Lab ID:	062107347-0092	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 4/23/2021 04:06 PM
 Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description		RUFSD-0126	Collected:	4/23/2021	Lab ID:	062107347-0092		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.4	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0127	Collected:	4/23/2021	Lab ID:	062107347-0093		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0128	Collected:	4/23/2021	Lab ID:	062107347-0094		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0130	Collected:	4/23/2021	Lab ID:	062107347-0095		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0131	Collected:	4/23/2021	Lab ID:	062107347-0096		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0992	Collected:	4/23/2021	Lab ID:	062107347-0097		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0993	Collected:	4/23/2021	Lab ID:	062107347-0098		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0	µg/L	4/28/2021	DI	4/29/2021	AL
Client Sample Description		RUFSD-0994	Collected:	4/23/2021	Lab ID:	062107347-0099		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107347

CustomerID: JC BR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 4/23/2021 04:06 PM
Collected: 4/23/2021

Project: #19-45373, Washington-Rose Elementary School, Roosevelt Union Free School District, 2 Rose Avenue, Roosevelt, NY 11575

Analytical Results

Client Sample Description RUFSD-0994 **Collected:** 4/23/2021 **Lab ID:** 062107347-0099

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0995 **Collected:** 4/23/2021 **Lab ID:** 062107347-0100

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	4/28/2021	DI	4/29/2021	AL

Client Sample Description RUFSD-0996 **Collected:** 4/23/2021 **Lab ID:** 062107347-0101

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.1	3.0 µg/L	4/29/2021	AM	4/30/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

Attachment 3:

Laboratory Certifications


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

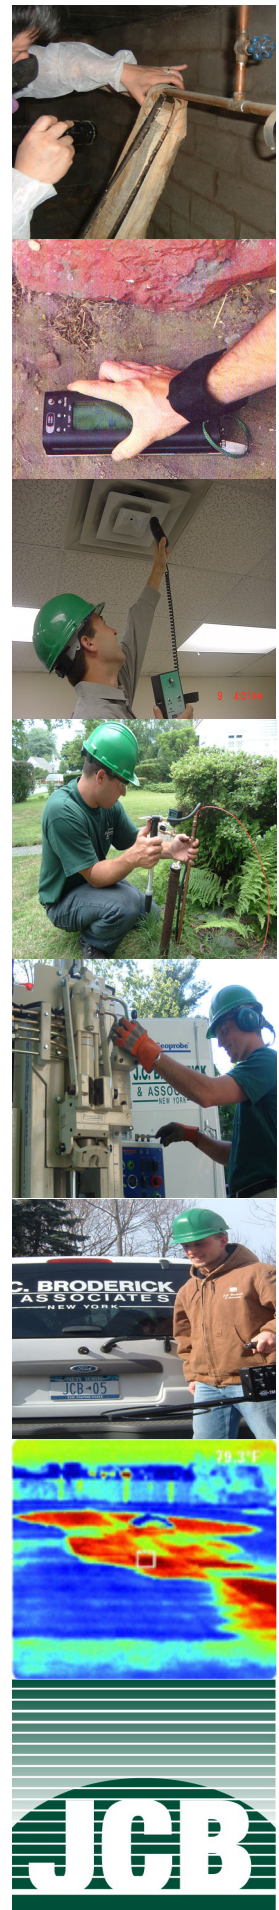

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Enterococci	SM 20, 23 9230C (Budnick 1996)
Heterotrophic Plate Count	SimPlate SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5
-------------	-----------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------

NEW YORK
STATE OF
OPPORTUNITY

Department
of Health

Serial No.: 62991

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

